




Engineering and Operating Guide

*for DOWTHERM SR-1 and DOWTHERM 4000
Inhibited Ethylene Glycol-based Heat Transfer Fluids*

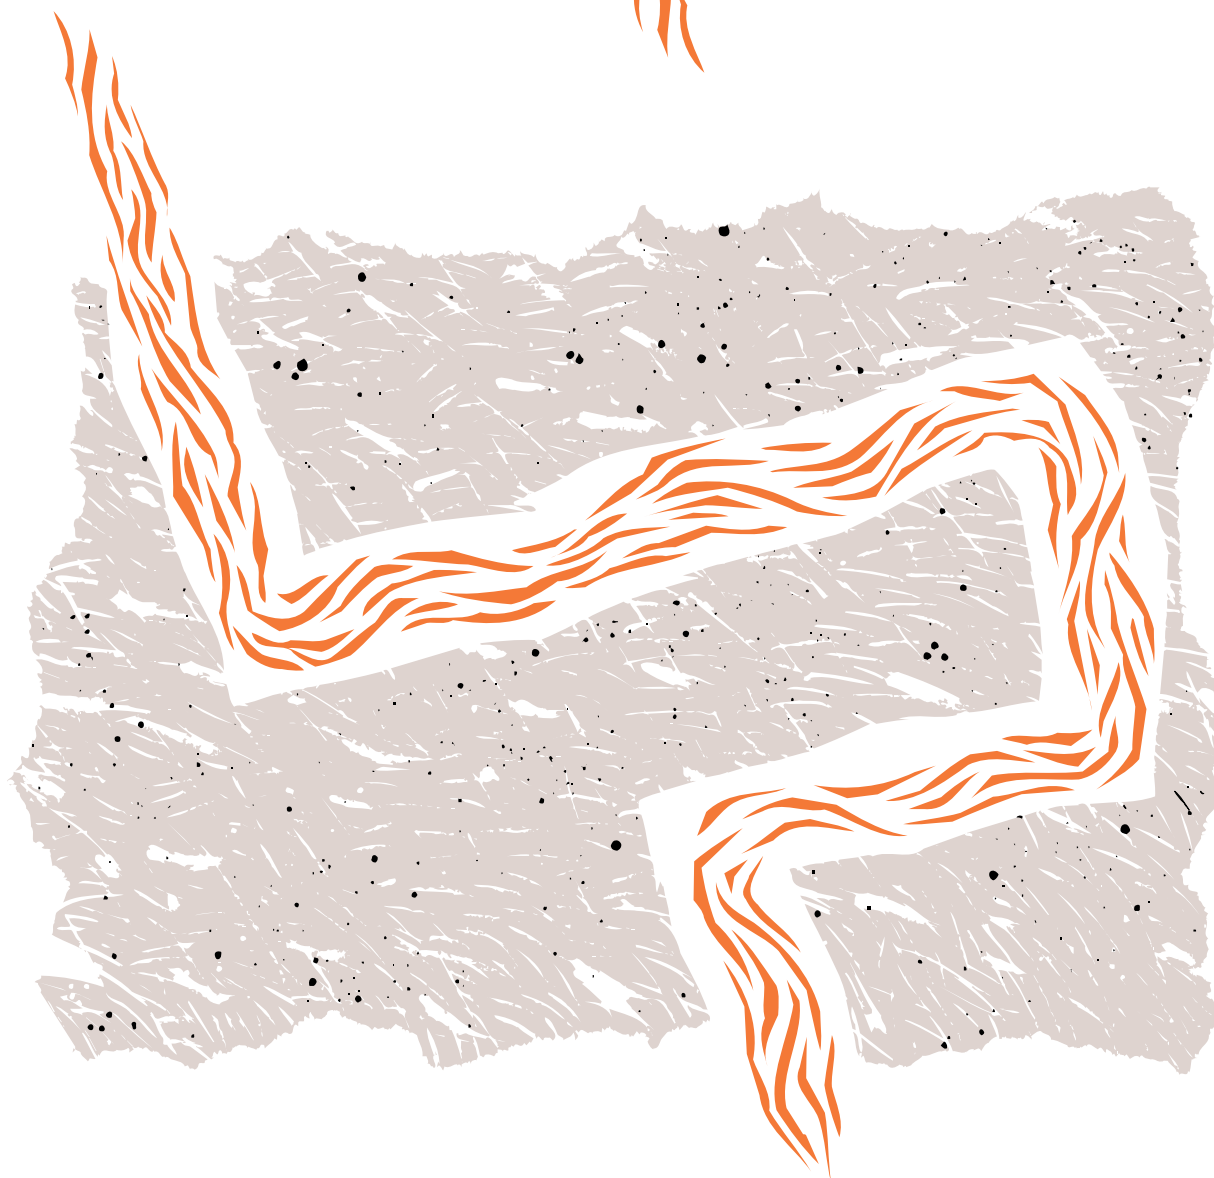

D O W T H E R M

TABLE OF CONTENTS

Introduction	4
Product Descriptions.....	5
Regulatory Status	7
System Preparation	7
Fluid Concentration	8
Preparing Fluid Solutions	9
Dilution Water Quality.....	9
Solution Make-up	9
Introducing DOWTHERM Fluids	9
Adjusting the Concentration of Inhibited Glycols.....	9
System Design Considerations	11
Corrosion Protection	14
Fluid Maintenance.....	15
Product Properties and Engineering Data.....	16
Density.....	18
Viscosity.....	22
Thermal Conductivity	26
Specific Heat	30
Vapor Pressure	34
Pressure Drop.....	36
Safety, Handling, Storage, Disposal	42
Product/Application Information Available	43

INTRODUCTION

This guide provides basic product performance information, engineering data, and operating guidelines for DOWTHERM® inhibited ethylene glycol-based heat transfer fluids. Included in the guide are: a brief introduction to DOWTHERM fluids, typical product specifications, system design and preparation guidelines, glycol concentration and dilution water quality information, plus detailed engineering data including density, viscosity, specific heat and thermal conductivity. If you would like additional product information or specific engineering or operating assistance, call Dow toll free at 1-800-447-4369.

Where to use DOWTHERM ethylene glycol-based fluids

Solutions of DOWTHERM ethylene glycol-based fluids are widely used for secondary cooling and heating applications, for freeze and burst protection of pipes, and for various deicing, defrosting, and dehumidifying applications. They contain specially formulated packages of industrial inhibitors that help prevent corrosion. Specific applications for these fluids include:

- HVAC system freeze/burst/corrosion protection
- Cold room dehumidifying
- Refrigeration coil defrosting
- Process cooling
- Conveyor roller defrosting
- Ice skating rinks
- Process heating
- Air preheating
- Waste heat recovery
- Sidewalk snow melting systems
- Solar heating
- Refrigeration warehouse floor heating

®Trademark of The Dow Chemical Company

Choosing between ethylene glycol and propylene glycol fluids

In addition to DOWTHERM ethylene glycol-based fluids, DOWFROST® propylene glycol-based fluids are also available. There are two major differences between ethylene and propylene glycol fluids: viscosity and toxicity. Ethylene glycol-based fluids are less viscous than propylene glycol-based fluids. Therefore, they generally provide superior heat transfer efficiency and better low temperature performance and are preferred for most heat transfer applications. However, in applications where toxicity is a concern, propylene glycol fluids are used because of their low acute oral toxicity vs. the moderate toxicity of ethylene glycols. Examples include applications where contact with drinking water is possible, food processing applications where accidental contact with food or beverage products could occur, and applications in localities where propylene glycol use is mandated by law. For additional toxicity information, see the discussion on page 42 of this brochure and request Material Safety Data (MSD) sheets from Dow.

This guide provides information about DOWTHERM ethylene glycol-based fluids only. For additional information about DOWFROST propylene glycol-based fluids, call 1-800-447-4369 and request Form No. 180-01286, "Engineering and Operating Guide for DOWFROST and DOWFROST HD Inhibited Propylene Glycol-based Heat Transfer Fluids."

Dow offers you a choice of ethylene glycol-based fluids

There are two Dow ethylene glycol-based fluids:

DOWTHERM SR-1: An industrially inhibited fluid with an operating range of -60°F to 250°F (-51°C to 121°C).

DOWTHERM 4000: An industrially inhibited fluid with an operating range of -60°F to 350°F (-51°C to 177°C).

Compared to DOWTHERM SR-1 fluid, DOWTHERM 4000 fluid has a higher maximum operating temperature, higher reserve alkalinity and greater thermal stability. While DOWTHERM SR-1 fluid is considered the standard ethylene glycol-based fluid for most applications, DOWTHERM 4000 fluid is specified to extend fluid life where service temperatures are higher and the likelihood of thermal degradation is greater. It is sometimes also used in less demanding applications because the heavy duty inhibitors last longer, and maintenance requirements can be reduced.

Complete supporting services including free fluid analysis

DOWTHERM ethylene glycol-based heat transfer fluids are backed by a comprehensive package of Dow supporting services. Dow technical service personnel can provide you with fluid related information to better enable you to design, operate, and maintain your thermal fluids system for maximum productivity and economy.

For systems containing 250 gallons (950 liters) of DOWTHERM fluid or more, Dow offers free fluid analysis. Typically performed on an annual basis, the analysis includes determination of current fluid inhibitor and glycol levels, plus Dow's recommendations for maintaining proper corrosion protection and thermal performance capabilities. Dow also provides assistance to operators of smaller systems so they can conduct their own, on-site fluid analyses. See page 15 for more information.

BASIC PRODUCT DESCRIPTIONS: DOWTHERM SR-1 AND DOWTHERM 4000 HEAT TRANSFER FLUIDS

DOWTHERM SR-1 fluid is a formulation of 95.4 percent ethylene glycol and a specially designed package of industrial corrosion inhibitors. The fluid is dyed fluorescent pink for leak detection purposes. It has an operating temperature range of -60°F to 250°F (-51°C to 121°C) and solutions in water provide freeze protection to below -60°F (-51°C) and burst protection to below -100°F (-73°C).

DOWTHERM 4000 fluid is a formulation of 92.4 percent ethylene glycol and a specially designed package of industrial corrosion inhibitors. The fluid is dyed fluorescent orange to aid in leak detection. It has an operating temperature range of -60°F to 350°F (-51°C to 177°C) and solutions in water provide freeze protection to below -60°F (-51°C) and burst protection to below -100°F (-73°C).

Both fluids are practically odorless and are moderate in acute oral toxicity. They offer excellent freeze and corrosion protection without significant reduction in heat transfer performance. These fluids are hygroscopic at low temperatures, which means they attract moisture from the surrounding atmosphere—important in dehumidification

applications. Both fluids are non-flammable in solutions up to 80 percent glycol in water. Table 1 highlights typical specifications of DOWTHERM SR-1 and DOWTHERM 4000 heat transfer fluids. Table 2 provides electrical conductivity data for DOWTHERM SR-1 fluid. Table 3 provides freezing and boiling points for DOWTHERM SR-1 and DOWTHERM 4000.

Table 1 — Typical Product Physical Properties[†]

	DOWTHERM SR-1 Heat Transfer Fluid	DOWTHERM 4000 Heat Transfer Fluid
Composition (% by weight)		
Ethylene Glycol	95.4	92.4
Inhibitors & Water	4.6	7.6
Color	Fluorescent Pink	Fluorescent Orange
Specific Gravity (at 60/60°F)	1.122 — 1.132	1.133 — 1.143
pH of Solution (50% glycol)	9.0 — 10.5	8.5 — 9.0
Reserve Alkalinity (min.)	12.0 ml	23.0 ml

[†]Typical properties, not to be construed as specifications.
Complete sales specifications are available on request.

**Table 2 — Electrical Conductivity of
DOWTHERM SR-1 Fluid**

Weight % Glycol	Temperature °C	Electrical Conductivity mhos/cm (S)
0	25	9.69 x 10 ⁻⁷
12.5	25	2.45 x 10 ⁻³
25.0	25	3.48 x 10 ⁻³
50.0	25	3.42 x 10 ⁻³
100.0	25	8.66 x 10 ⁻⁴
0	0	9.69 x 10 ⁻⁷
12.5	0	1.39 x 10 ⁻³
25.0	0	1.74 x 10 ⁻³
50.0	0	1.56 x 10 ⁻³
100.0	0	3.29 x 10 ⁻⁴

Table 3 — Typical Freezing and Boiling Points of Aqueous Solutions of DOWTHERM SR-1 and DOWTHERM 4000[†]

Freezing Point		Wt % Ethylene Glycol	Vol % Ethylene Glycol	Vol % DOWTHERM SR-1	Vol % DOWTHERM 4000	Boiling Point		Refractive Degree Brix ^{††}	Index 22°C
°F	°C					°F 760 mm Hg	°C @ 0.96 Barr		
32.0	0.0	0.0	0.0	0.0	0.0	212.0	100.0	0.0	1.3328
29.4	-1.4	5.0	4.4	4.6	4.8	213.0	101.0	3.8	1.3378
26.2	-3.2	10.0	8.9	9.3	9.6	214.0	101.0	6.8	1.3428
22.2	-5.4	15.0	13.6	14.2	14.7	215.0	102.0	9.9	1.3478
17.9	-7.8	20.0	18.1	19.0	19.6	216.0	102.0	13.0	1.3530
16.8	-8.4	21.0	19.2	20.1	20.8	216.0	102.0	13.7	1.3540
15.9	-8.9	22.0	20.1	21.0	21.8	216.0	102.0	14.3	1.3551
14.9	-9.5	23.0	21.0	22.0	22.7	217.0	103.0	14.8	1.3561
13.7	-10.2	24.0	22.0	23.0	23.8	217.0	103.0	15.5	1.3572
12.7	-10.7	25.0	22.9	24.0	24.8	218.0	103.0	16.1	1.3582
11.4	-11.4	26.0	23.9	25.0	25.9	218.0	103.0	16.7	1.3593
10.4	-12.0	27.0	24.8	26.0	26.8	218.0	103.0	17.3	1.3603
9.2	-12.6	28.0	25.8	27.0	27.9	219.0	104.0	17.9	1.3614
8.0	-13.3	29.0	26.7	28.0	28.9	219.0	104.0	18.6	1.3624
6.7	-14.1	30.0	27.7	29.0	30.0	220.0	104.0	19.2	1.3635
5.4	-14.8	31.0	28.7	30.2	31.1	220.0	104.0	19.8	1.3646
4.2	-15.4	32.0	29.6	31.0	32.0	220.0	104.0	20.4	1.3656
2.9	-16.2	33.0	30.6	32.0	33.1	220.0	104.0	21.0	1.3667
1.4	-17.0	34.0	31.6	33.1	34.2	220.0	104.0	21.7	1.3678
-0.2	-17.9	35.0	32.6	34.1	35.3	221.0	105.0	22.3	1.3688
-1.5	-18.6	36.0	33.5	35.1	36.3	221.0	105.0	22.9	1.3699
-3.0	-19.4	37.0	34.5	36.1	37.3	221.0	105.0	23.5	1.3709
-4.5	-20.3	38.0	35.5	37.2	38.4	221.0	105.0	24.1	1.3720
-6.4	-21.3	39.0	36.5	38.2	39.5	221.0	105.0	24.7	1.3730
-8.1	-22.3	40.0	37.5	39.3	40.6	222.0	106.0	25.3	1.3741
-9.8	-23.2	41.0	38.5	40.3	41.7	222.0	106.0	25.9	1.3752
-11.7	-24.3	42.0	39.5	41.4	42.7	222.0	106.0	26.5	1.3763
-13.5	-25.3	43.0	40.5	42.4	43.8	223.0	106.0	27.1	1.3774
-15.5	-26.4	44.0	41.5	43.5	44.9	223.0	106.0	27.7	1.3785
-17.5	-27.5	45.0	42.5	44.5	46.0	224.0	107.0	28.3	1.3796
-19.8	-28.8	46.0	43.5	45.5	47.1	224.0	107.0	28.8	1.3807
-21.6	-29.8	47.0	44.5	46.6	48.2	224.0	107.0	29.4	1.3817
-23.9	-31.1	48.0	45.5	47.6	49.2	224.0	107.0	30.0	1.3828
-26.7	-32.6	49.0	46.6	48.8	50.4	224.0	107.0	30.7	1.3838
-28.9	-33.8	50.0	47.6	49.8	51.4	225.0	107.0	31.2	1.3849
-31.2	-35.1	51.0	48.6	50.9	52.6	225.0	107.0	31.7	1.3859
-33.6	-36.4	52.0	49.6	51.9	53.7	225.0	107.0	32.3	1.3869
-36.2	-37.9	53.0	50.6	53.0	54.8	226.0	108.0	32.8	1.3879
-38.8	-39.3	54.0	51.6	54.0	55.8	226.0	108.0	33.3	1.3890
-42.0	-41.1	55.0	52.7	55.2	57.0	227.0	108.0	33.9	1.3900
-44.7	-42.6	56.0	53.7	56.2	58.1	227.0	108.0	34.4	1.3910
-47.5	-44.2	57.0	54.7	57.3	59.2	228.0	109.0	35.0	1.3921
-50.0	-45.6	58.0	55.7	58.3	60.3	228.0	109.0	35.5	1.3931
-52.7	-47.1	59.0	56.8	59.5	61.5	229.0	109.0	36.0	1.3942
-54.9	-48.3	60.0	57.8	60.5	62.6	230.0	110.0	36.6	1.3952
b	b	65.0	62.8	65.8	68.0	235.0	113.0	39.1	1.4003
b	b	70.0	68.3	71.5	73.9	242.0	117.0	41.7	1.4055
b	b	75.0	73.6	77.1	79.7	248.0	120.0	44.2	1.4107
-52.2	-46.8	80.0	78.9	82.6	85.4	255.0	124.0	46.6	1.4159
-34.5	-36.9	85.0	84.3	88.3	91.2	273.0	134.0	49.0	1.4208
-21.6	-29.8	90.0	89.7	93.9	97.1	285.0	141.0	51.2	1.4255
-3	-19.4	95.0	95.0	99.5	a	317.0	158.0	53.2	1.4300

^a Ethylene glycol concentrations greater than 92% are not attainable with DOWTHERM 4000 fluid.

^b Freezing points are below -60°F (-51°C).

[†] Typical properties, not to be construed as specifications.

^{††} Degree Brix is a measure of the sugar concentration in a fluid and is important in fermentation and syrups applications. Although there is no sugar present in DOWTHERM heat transfer fluids, the glycol affects the refractive index of the fluid in a similar fashion.

NOTE: Generally, for an extended margin of protection, you should select a temperature in this table that is at least 5°F (3°C) lower than the expected lowest ambient temperature. Inhibitor levels in glycol solutions less than 25-30% may not provide adequate corrosion protection. Solutions of glycol less than 25% may be at risk for bacterial contamination.

REGULATORY STATUS OF DOWTHERM SR-1 FLUID

DOWTHERM SR-1 inhibited ethylene glycol-based fluid is listed as chemically acceptable by the U.S. Department of Agriculture (USDA) for defrosting refrigeration coils in food processing plants operated under federal inspection, assuming good manufacturing practices are used to prevent direct or indirect contact of the glycol fluid with edible products. Meat packing establishments sometimes require a letter certifying the appropriate use and quality of DOWTHERM SR-1 fluid. Such a letter, along with copies of the acceptance letter from the USDA, will be provided to Dow customers on request.

For applications where accidental contact with food or beverage products is possible, where there is a possibility of incidental contact with drinking water, or where health or environmental regulations apply, DOWFROST propylene glycol-based fluids should be used. (Request Form No. 180-01286, "Engineering and Operating Guide for DOWFROST and DOWFROST HD Inhibited Propylene Glycol-based Heat Transfer Fluids.")

PREPARING SYSTEMS FOR THE ADDITION OF DOWTHERM SR-1 OR DOWTHERM 4000 HEAT TRANSFER FLUID

Existing systems

In existing systems, all lines and materials should be cleaned and flushed thoroughly before charging the system with DOWTHERM fluid. This is especially important if fluid previously in the system is incompatible with the new inhibited glycol fluid. A Dow technical service representative can help you determine the compatibility of other fluids with DOWTHERM SR-1 and DOWTHERM 4000 heat transfer fluids.

If a fluid containing silicates (such as automotive antifreeze) was previously used, it may be necessary to clean silicate residues from the system.

It is also important to remove all rust, scale, and sediment in the system. Chloride ions should be removed—whether from old fluid or residue from acid cleaner—because chlorides can contribute to corrosion. For large systems, or systems where corrosion is already evident, consult a professional industrial cleaning organization. For heavily fouled or corroded systems, an optimum cleaning procedure includes the use of an inhibited acid followed by neutralization and phosphatization. This procedure may be quite involved and should be done by a

company experienced in industrial cleaning. If chemical cleaning is used, it is important that all traces of the cleaning agent be removed, and the system be thoroughly flushed with water.

New systems

New systems are typically coated with oil, grease or a protective film during fabrication, storage, or construction. Dirt, solder flux, and welding and pipe scale can also cause problems. Therefore, thorough cleaning of new systems is recommended. A solution of 1 to 2 percent trisodium phosphate can be used with water for flushing the system. Other commercially available cleaning products may also work. System volume can be calculated during this stage by metering in the initial fill of the system, or by chemical analysis of cleaning chemicals after known quantities are introduced into the system.

SELECTING THE PROPER CONCENTRATION OF DOWTHERM FLUID

The minimum recommended concentration is 25% as glycol for most applications. Diluting the concentration below 25% to 30% as glycol may reduce the inhibitor concentration to a level that may not provide adequate corrosion protection. Solutions of glycol less than 25% may be at risk for bacterial contamination. The maximum recommended concentration of glycol is 60% for efficient heat transfer.

Between 25% and 60%, the actual concentration of glycol-based heat transfer fluid required in a system depends on the kind of protection needed in winter, or the operating temperature if the system involves refrigeration. There are two basic types of protection available: “burst protection” and “freeze protection.”

Burst protection

Burst protection is sufficient if the system will remain dormant when the temperature is below the freezing point of the solution. In HVAC applications, burst protection is considered an appropriate safeguard in systems where there is adequate space to accommodate the expansion of an ice/slush mixture *and* the system is inactive during the winter.

Inhibited glycol-based fluids provide burst protection in the following manner: As the temperature drops below the solution’s freezing point, ice crystals begin to form. Because water in the solution freezes first, the remaining glycol solution becomes further concentrated and remains fluid. The combination of ice crystals and fluid results in a flowable slush. Fluid volume increases as this slush forms, with the extra volume flowing into available expansion volume in the system. If the concentration of glycol is sufficient, system damage will not occur.

For burst protection, a 30 percent (by volume) solution of ethylene

glycol (31.4 percent DOWTHERM SR-1 or 32.5 percent DOWTHERM 4000) is usually adequate. See Table 4 for typical ethylene glycol concentrations required to achieve burst protection at various temperatures.

Freeze protection

Freeze protection is required in systems where fluid must be pumped at the lowest anticipated temperature. Freeze protection is essential in cases where no ice crystals can be permitted to form or where there is inadequate expansion volume available to accommodate ice/slush formation.

For freeze protection, the required concentration of inhibited glycol fluid in the system depends on the operating conditions of the system

and the lowest expected ambient temperature. HVAC systems that are subject to prolonged winter shut-down—but which must start-up again while the weather is still cold—may require freeze protection. Freeze protection is also appropriate for closed-loop systems that must be protected in the event of power or pump failure.

To obtain adequate freeze protection, the glycol solution must maintain a freezing point at least 5°F (3°C) below the lowest anticipated ambient temperature. Table 4 lists typical concentrations of DOWTHERM fluids required to provide freeze protection. Refer to Table 3 for a complete list of the concentrations of inhibited ethylene glycol to be added for freeze protection.

Table 4 — Typical Concentrations of DOWTHERM Fluids Required to Provide Freeze and Burst Protection at Various Temperatures

Temperature °F °C	Percent (vol.) DOWTHERM Fluid Concentration Required			
	For Freeze Protection		For Burst Protection	
	Volume % DOWTHERM SR-1	Volume % DOWTHERM 4000	Volume % DOWTHERM SR-1	Volume % DOWTHERM 4000
20 (-7)	16.8 [†]	17.3 [†]	11.5 [†]	11.9 [†]
10 (-12)	26.2	27.1	17.8 [†]	18.4 [†]
0 (-18)	34.6	35.7	23.1 [†]	23.8 [†]
-10 (-23)	40.9	42.2	27.3	28.1
-20 (-29)	46.1	47.6	31.4	32.5
-30 (-34)	50.3	51.9	31.4	32.5
-40 (-40)	54.5	56.3	31.4	32.5
-50 (-46)	58.7	60.6	31.4	32.5
-60 (-51)	62.9	64.9	31.4	32.5

NOTE: These figures are examples only and may not be appropriate to your situation. Generally, for an extended margin of protection, you should select a temperature in this table that is at least 5°F (3°C) lower than the expected lowest ambient temperature.

ATTENTION: These are typical numbers only and are not to be regarded as specifications. As use conditions are not within its control, Dow does not guarantee results from use of the information or products herein; and gives no warranty, express or implied.

[†] Inhibitor levels in glycol solutions less than 25–30% may not provide adequate corrosion protection. Solutions of glycol less than 25% may be at risk for bacterial contamination.

PREPARING SOLUTIONS OF DOWTHERM FLUIDS

Dilution water quality

Water used to dilute DOWTHERM fluids must meet certain minimum standards for purity. Impurities in dilution water can increase metal corrosion, aggravate pitting of cast iron and steel, reduce the effectiveness of corrosion inhibitors, increase inhibitor depletion rate, cause formation of scale and other deposits on heat transfer surfaces, and cause clogging of system components.

To assure inhibitor effectiveness, the levels of chlorides and sulfates in water used to dilute DOWTHERM fluids should be less than 25 ppm each. Total hardness should be less than 100 ppm (see Table 5). Distilled or deionized water is recommended. DOWTHERM SR-1 and DOWTHERM 4000 fluids contain a patented additive that keeps the corrosion inhibitors in solution when mixed with hard water ions (calcium and magnesium). This helps to protect the system from depletion of the inhibitor package due to accidental use of hard water. However, since additional contaminants are typically found in hard water (such as chloride, sulfate, iron, etc.), Dow continues to recommend the use of distilled or deionized water for dilution of these products.

If good quality water is unavailable, pre-diluted solutions of DOWTHERM fluids are available from Dow.

Table 5 — Dilution Water Quality Requirements

Impurity	Level
Chlorides	25 ppm, max
Sulfates	25 ppm, max
Total Hardness, as CaCO ₃	100 ppm, max

NOTE: 17.1 ppm = 1 grain

Solution make-up

As indicated above, good quality water must be used for fluid make-up. In addition, any flush water remaining in the system should be taken into account when introducing and diluting DOWTHERM fluids. In an industrial system, it is not unusual to have “hold-up” of up to 20 percent or greater of the total system volume, although 10 percent is more common.

Introducing DOWTHERM fluids into your system

In most cases, solutions containing glycol-based heat transfer fluid are mixed on a volume basis. If you wish to mix by weight percent, use Table 3 to obtain the volume-to-weight conversion. Following is the mixing procedure for installing these fluids:

1. Calculate the quantity of fluid needed to achieve the desired results. Tables 6 and 7, which provide the volume of fluid per length of pipe, may be helpful in the calculation.

2. Introduce a sufficient quantity of water to check the system for tightness. Pressure testing the system at this stage can be helpful. Often pressure testing can be accomplished during the initial cleaning or flushing of the system.

3. Drain enough water from the system to provide space for the inhibited glycol quantity as calculated in Step 1.

4. Add the correct amount of fluid and any water needed to completely refill the system, allowing for liquid expansion as needed due to the operating temperature.

5. Circulate for at least 24 hours to ensure complete mixing. Circulation through the expansion tank during this time will improve mixing. Check the liquid concentration with a refractometer or other method to assure that the correct mixture has been obtained.

Increasing or decreasing the concentration of inhibited glycol in the system

It is sometimes necessary to increase the concentration of the glycol solution in your system, either to protect against cold weather, or to replace fluid lost through leakage or moisture absorbed from the atmosphere. There are other conditions which may require the dilution of inhibited glycol already in your system. Either adjustment can be carried out in batch or continuous operation.

Procedure for adjusting freezing point of glycol fluids

If a lower freezing point is required, the concentration of glycol must be increased accordingly. Use the formula below to determine the amount of solution to drain and the number of gallons of DOWTHERM fluid to add to increase glycol concentration.

$$A = V(D-P)/(100-P)$$

To decrease the glycol concentration, the following formula should be used to determine the volume to drain and replace with high quality water:

$$A = V(P-D)/P$$

Where,

A= The quantity (in gallons or liters) of DOWTHERM fluid to be added to the system to lower the freeze point, or the quantity (in gallons or liters) of glycol solution that must be drained from the system to decrease glycol concentration.

V= The total solution capacity of the system, in gallons (or liters).

D= The volume percent of DOWTHERM fluid desired in the system.

P= The volume percent of DOWTHERM fluid presently in the system.

Table 6 — Volume of Heat Transfer Fluid per length of Pipe[†]

Nominal Pipe Size inches	Nominal Pipe Size mm	Wall Thickness inches	Wall Thickness mm	Inside Diameter inches	Inside Diameter mm	USG per 100 ft of pipe	Liters per 1 m of pipe
1/4	8	0.088	2.24	0.364	9.25	0.541	0.067
3/8	10	0.091	2.31	0.493	12.52	0.992	0.123
1/2	15	0.109	2.77	0.622	15.80	1.579	0.196
3/4	20	0.113	2.87	0.824	20.93	2.770	0.344
1	25	0.133	3.38	1.049	26.64	4.490	0.558
1 1/4	32	0.14	3.56	1.380	35.05	7.770	0.965
1 1/2	40	0.145	3.68	1.610	40.89	10.576	1.313
2	50	0.154	3.91	2.067	52.50	17.433	2.165
2 1/2	65	0.203	5.16	2.469	62.71	24.873	3.089
3	80	0.216	5.49	3.068	77.93	38.406	4.769
3 1/2	90	0.226	5.74	3.548	90.11	51.363	6.378
4	100	0.237	6.02	4.026	102.26	66.135	8.213
5	125	0.258	6.55	5.047	128.19	103.933	12.906
6	150	0.28	7.11	6.065	154.05	150.089	18.638
8	200	0.322	8.18	7.981	202.70	259.897	32.274
10	250	0.365	9.27	10.020	254.50	409.659	50.871
12	300	0.406	10.31	11.938	303.20	581.501	72.211

[†] Commercial steel pipe — schedule 40 and standard weight as per ASTM B36.10.

SYSTEM DESIGN CONSIDERATIONS

Following is a general discussion of system design and other engineering considerations related to the use of DOWTHERM inhibited ethylene glycol-based heat transfer fluids. For information regarding a specific system problem or question, contact Dow's technical service and development staff for assistance at 1-800-447-4369.

Materials of construction

Standard system materials can be used with DOWTHERM heat transfer fluids. Steel, cast iron, copper, brass, bronze, solder and most plastic piping materials are all generally acceptable. DOWTHERM fluids can also be used with aluminum at temperatures below 150°F (66°C). At temperatures above 150°F (66°C), use of aluminum is not recommended because the inhibitors will not fully protect aluminum components in the system. Galvanized steel is not recommended because the zinc will react with the inhibitor in the fluids, causing precipitate formation, depletion of the inhibitor package, and removal of the protective zinc coating, particularly above 100°F (38°C). Precipitation can also lead to localized corrosion.

Centrifugal pumps are commonly used with solutions of DOWTHERM fluids. Reciprocating pumps are necessary where fluids must be pumped at high head pressures. Pumps can be made of ordinary steel or ductile iron since the fluids are inhibited.

Piping, valves, and fittings can also be made of ordinary steel or ductile iron. Use of gray iron components is not recommended.

Typically, the same types of pump packing or mechanical seals used for water may be used with solutions of DOWTHERM fluids. Packing and seal manufacturers should be consulted for materials appropriate to your application and operating temperature.

Solutions of DOWTHERM fluids are also compatible with most plastics and elastomers. Generally, any material that can be used with uninhibited glycols may be used with DOWTHERM fluids. Before using a particular elastomer, check with the manufacturer to determine the suitability of the material with ethylene glycol over the anticipated temperature and pressure ranges.

If the use of coatings is desired (for example, to protect the vapor space of an expansion tank), several options are available.

Suitable coatings include novolac-based vinyl ester resins (e.g., DERAKANE* 470-36 vinyl ester resin), high-bake phenolic resins, polypropylene, and polyvinylidene fluoride. To ensure the coating is suitable for a particular application and temperature, the manufacturer should be consulted.

Bypass filters are recommended for removal of foreign solids. This is especially important if the quality of dilution water does not conform to the recommendations on page 9 of this guide. Precipitates and sludge deposited by solution water can lead to localized corrosion. Filters made of non-absorbent cotton, fiber, or cellulose-type media have been used successfully.

Using dissimilar metals in a system is not recommended because galvanic corrosion may result. This type of corrosion can occur in electrolytic solutions when dissimilar metals (referencing the galvanic series in sea water) are in contact with, or are near, each other.

(Aluminum directly connected to copper is an example.) Solutions of DOWTHERM fluids are better than plain water, but still cannot protect against galvanic corrosion of dissimilar metals electrically coupled in a system. Electrical isolation eliminates galvanic corrosion concerns.

*Trademark of The Dow Chemical Company

Fluid temperature range and system design

DOWTHERM SR-1 inhibited glycol-based fluid has an effective operating temperature range of -60°F to 250°F (-51°C to 121°C), while DOWTHERM 4000 inhibited glycol-based fluid is effective from -60°F to 350°F (-51°C to 177°C). At temperatures below -20°F (-29°C), increased viscosity (>200 cPs [$>200 \text{ mPa}\cdot\text{s}$]) can make use of these fluids impractical unless larger pumps are installed.

At the upper end of the operating range for DOWTHERM SR-1 fluid, a maximum bulk temperature of 250°F (121°C) is recommended. Film temperatures should not exceed 300°F (149°C). In the case of DOWTHERM 4000 fluid, a maximum bulk temperature of 350°F (177°C) is recommended, with film temperatures not to exceed 400°F (204°C).

DOWTHERM SR-1 and DOWTHERM 4000 fluids can tolerate brief temperature excursions up to 100°F (56°C) above the maximum recommended temperatures. However, extended exposure of the fluids to temperatures in excess of 50°F (28°C) above the maximum recommended temperatures will result in accelerated degradation of the glycol and inhibitor systems.

In addition, the film temperature should remain within 50°F of the bulk fluid temperature and the pressure at all points in the system should be at least 5 psi (35kPa) greater than the vapor pressure exerted by the fluid to avoid localized boiling and resulting precipitation.

At temperatures above 150°F (66°C), the system must be closed to avoid rapid oxidation of the ethylene glycol, inhibitor depletion, and subsequent increased corrosion.

Automatic make-up water systems

Automatic make-up water systems should be avoided in order to prevent undetected dilution or loss of glycol and consequent loss of freeze and corrosion protection.

Glycol feed tanks that deliver the same concentration of fluid as being used in the system, coupled with a low-level alarm, are recommended.

Flammability

When mixed with water, neither DOWTHERM SR-1 nor DOWTHERM 4000 fluids are flammable because they have no measurable flash point (Pensky-Martens Closed Cup) in concentrations up to 80 percent glycol. Undiluted DOWTHERM SR-1 fluid has a flash point of 239°F (115°C) (Tag Closed Cup). Undiluted DOWTHERM 4000 fluid has a flash point of 252°F (122°C) (Setaflash). It is possible to ignite solutions of ethylene glycol if enough water has been vaporized and the concentration of ethylene glycol increases to greater than 80 percent.

Film coefficients of inhibited glycols and water

The film coefficient of a fluid must be determined in order to evaluate the heat transfer surface required. Since solutions of DOWTHERM SR-1 and DOWTHERM 4000 fluids have heat transfer properties different from those of plain water, they typically have lower film coefficients under equivalent flow conditions.

This may affect the design and operation of the system, depending on factors such as the heat transfer coefficient of the material being heated or cooled. Additional discussion of film coefficient and a method of calculating it appear on page 16 of this brochure.

The FLUIDFILE* software program, available exclusively from Dow, is designed to calculate fluid film coefficient based on your specific operating conditions. This fast, accurate engineering tool is available without charge. Just call toll free: 1-800-447-4369.

Efficiency vs. concentration

To obtain maximum heat transfer efficiency while achieving adequate freeze protection, avoid using excess concentrations of DOWTHERM fluids in water. Generally when the fluid is used for either freeze protection or secondary cooling, the specified concentration should yield a freezing point about 5°F (3°C) lower than the lowest anticipated temperature. For burst protection, when slush (or ice crystals) in the fluid is not a problem, consult Table 4 on page 8. It is rarely necessary to use concentrations higher than 50 to 55 percent glycol in water. The less glycol used, the higher the relative heat transfer efficiency of the solution.

For optimum corrosion protection, the concentration of DOWTHERM fluid in water should provide at least 30 percent (by volume) glycol for hot applications and 25% (by volume) for others. If operation at lower concentrations is desired, consult your Dow technical service representative for information.

*Trademark of The Dow Chemical Company

Expansion factor

Like any fluids, solutions of DOWTHERM fluids expand as temperature increases. Therefore, expansion tanks must be sized appropriately. To determine the volume required for expansion, use the following formula:

$$\frac{\rho(T_{\text{LOW}}) - \rho(T_{\text{HIGH}})}{\rho(T_{\text{HIGH}})} \times \text{Volume} = \frac{\text{Expansion}}{\text{Volume}}$$

Where,

$\rho(T_{\text{LOW}})$ = the density at the lowest anticipated temperature

$\rho(T_{\text{HIGH}})$ = the density at the highest anticipated temperature

Density data for DOWTHERM SR-1 and DOWTHERM 4000 fluids are given in Tables 10 through 13.

One method for sizing an expansion tank is to use the determined expansion volume to calculate the total size of the tank. A typical tank size would allow the fluid to fluctuate between the levels associated with 15% and 80% full. The tank size is calculated from:

$$\text{Expansion Volume} / .65 = \text{Tank Size}$$

When using this method, ensure that the minimum amount of fluid in the tank will provide the NPSH (net positive suction head) of the pump, if the tank is a portion of the source of head.

An alternative method of sizing the tank is to determine the volume of the system and specify a large enough tank to accommodate the entire fluid volume at maximum temperature. This method allows the system to be drained to the expansion tank for maintenance. Industrial users of DOWTHERM fluids will typically use this procedure.

Also note that, as temperatures drop below the freezing point of a glycol solution, ice crystals begin to form. This causes the solution to expand and the slush to flow to available expansion volume. The lower the temperature is, the greater the expansion. This expansion volume should be used for expansion tank sizing.

However, when it becomes cold enough for glycol crystals to form, the volume of the solution will contract. At very low temperatures, the entire mass freezes and contracts.

How to use glycols for HVAC freeze protection without sacrificing heat transfer efficiency

Compared to water, glycols are widely believed to have a negative impact on the performance of HVAC systems. In reality, however, the use of a glycol solution in a closed-loop, water-based HVAC system can have relatively little effect on how well that system performs, particularly if the system is prudently engineered.

If the system has excess design capacity, the decline in capacity resulting from the use of glycol will most likely not even be noticed by building occupants. On the other hand, if the system is already nearing its design load, the use of glycol might aggravate the situation. But any problems will only be noticed on the hottest days of the year.

In cases where the increase in pressure drop and resulting decline in capacity is a problem, a two-step solution can be employed. First, flow of solution through the system should be reduced in order to return the pressure drop to its original value. This will have the beneficial side effects of lowering pump horsepower requirements and reducing energy consumption. Next, reduce the chiller operating temperature to lower the fluid temperature into the coil. Reducing the chiller operating temperature compensates for the reduction in fluid flow and returns the coil capacity to its original level.

In some cases, this process of shifting the cooling burden from pumps to the chiller can actually improve the overall efficiency of the system. Unlike pumps, chillers only use energy in proportion to system load. And, chillers have become increasingly energy efficient in recent years.

HOW DOWTHERM INHIBITED FLUIDS PROTECT AGAINST CORROSION

DOWTHERM SR-1 and DOWTHERM 4000 glycol-based fluids contain specially formulated industrial inhibitor packages that are effective in preventing corrosion of metals commonly used in HVAC, food processing, and process heat transfer equipment. These inhibitors prevent corrosion of metals in two ways.

First, they passivate the surface of metals, reacting with the surface to prevent acids from attacking it. Unlike inhibitors used in some other fluids, Dow inhibitors perform this passivation process without fouling heat transfer surfaces. The inhibitors in automotive antifreeze, on the other hand, contain silicates that coat heat transfer surfaces with a thick silicate gel that reduces heat transfer.

Second, the inhibitors in DOWTHERM fluids buffer any acids formed as a result of glycol oxidation. All glycols produce organic acids as degradation products. This degradation is accelerated in the presence of oxygen and/or heat. Left in solution, such acids lower pH and contribute to corrosion. Properly formulated inhibitors such as those in DOWTHERM fluids neutralize these acids.

The standard ASTM D1384 corrosion test is a screening test that measures the relative corrosion protection provided by different solutions on standard metals under standard test conditions. The data in Table 8 show relative corrosion rates for DOWTHERM SR-1 and DOWTHERM 4000 fluids compared to uninhibited ethylene glycol and plain water. The data indicate that solutions of DOWTHERM fluids fall well within the generally accepted corrosion limits considered adequate under this test. Rates in excess of 0.5 mpy (2.5 mpy for aluminum) are generally evidence of inadequate corrosion protection. (Since it is

only a screening test, ASTM D1384 may not be indicative of performance in an actual system.)

The presence of excessive amounts (>25 ppm) of contaminants such as chlorides, sulfates, or ammonia could contribute to system corrosion not evident in these tests. For example, excessive concentrations of chloride ions will result in the formation of iron chloride. Iron chloride will react with any available oxygen to form iron oxide which is insoluble. The resulting deposition of precipitant forms an area where underdeposit corrosion can occur. This corrosion will be further accelerated by the presence of chlorides and cannot be eliminated by the use of a non-chromate-based inhibitor. This underscores the importance of solution water quality, discussed on page 9 of this guide.

Table 8 — Corrosion Test Results/Mils Penetration per Year (Weight Loss in Milligrams) Rates in Excess of 0.5 mpy (2.5 mpy for Aluminum) Are Generally Evidence of Inadequate Corrosion Protection.

	Water	Ethylene Glycol	DOWTHERM SR-1 Fluid	DOWTHERM 4000 Fluid
Copper	0.08 (2)	0.16 (4)	0.12 (3)	0.08 (2)
Solder	3.14 (99)	56.5 (1780)	0.13 (4)	0.13 (4)
Brass	0.23 (5)	0.46 (11)	0.12 (3)	0.08 (2)
Mild Steel	9.69 (212)	44.5 (974)	0.04 (1)	0.04 (1)
Cast Iron	21.2 (450)	55.7 (1190)	0.13 (3)	0.23 (5)
Aluminum	13.2 (110)	19.8 (165)	0.44 (4)	+0.12 (+1)

Samples with a "+" showed weight gain.

ASTM D1384—190°F (88°C) for 2 weeks. 30% by volume glycol, air bubbling.

MAINTAINING DOWTHERM HEAT TRANSFER FLUIDS WITHIN YOUR SYSTEM

Free analytical service from Dow

To help ensure that corrosion and freeze protection are maintained in customer systems, Dow offers a free fluid analysis service. This service is free for systems containing 250 gallons (950 liters) or more of DOWTHERM fluid. It is designed to assure the long-term performance of DOWTHERM fluids and help minimize replacement fluid requirements as well as system maintenance and repair costs. Typically performed on an annual basis, the analysis includes determination of current inhibitor and glycol levels, plus Dow's recommendations for maintaining proper corrosion protection.

Dow has developed special Thermal Fluids Sampling Kits for use by customers participating in the analysis program. These kits permit easy and accurate labeling of fluid samples and safe shipment of samples to Dow for analysis. Kits may be obtained by calling 1-800-447-4369. Or write:

The Dow Chemical Company
Larkin Lab
1691 North Swede Road
Midland, Michigan 48674
Thermal Fluids Testing Lab

How the service works

After the system has been filled and circulated for 24 hours, an initial four-ounce sample should be withdrawn and sent to Dow using one of the Thermal Fluids Sampling Kits.

After the system is in operation, it is recommended that samples be taken once a year. Before withdrawing a sample, the fluid should be well circulated in the system so the sample is representative. **Remember to closely follow the sampling instructions included with the sample kit provided by Dow.**

Proper sampling is essential to ensure meaningful assessment of fluid condition.

Approximately three weeks after the sample is received by Dow, a report will be sent to you detailing results of the analysis, discussing unusual or troublesome conditions (if any), and offering recommendations.

Analytical tools available for self-testing

Dow recommends that systems containing less than 250 gallons (950 liters) of DOWTHERM fluid be checked using on-site fluid analysis.

Misco Products refractometer, model 7084VP(°F) and 7064VP(°C)—

These refractometers measure the glycol solution concentration of DOWTHERM fluids and give the freezing points of the fluids. This portable instrument requires only a few drops of fluid for testing and requires no adjustment for fluid temperature. Diluted solutions with concentrations from 0 to 60% glycol may be tested directly. Stronger concentrations require a simple dilution procedure prior to testing. Contact Misco Products at 1-800-358-1100 and ask for the Dow discount.

Testing your fluid's pH level — Control of pH between 8 and 10 is important to minimize corrosion and glycol degradation. Using narrow range pH paper such as pHDrion Control paper with a 7.2 to 8.8 pH range is an easy and reliable way to read your pH level.

A pH tester can also measure alkalinity or acidity of the fluid. The pH should fall between 8.0 and 10.0. Adjustments can be made by using a 50% solution of sodium hydroxide or potassium hydroxide if the pH is between 7.0 and 8.0. Any fluid with a pH below 7.0 should be replaced. An inexpensive pH tester is available from Misco Products. The accuracy of this instrument is +/- 0.5 pH. Contact Misco Products at 1-800-358-1100 and ask for the Dow discount.

Also, you can quickly determine the condition of your fluid by examining its appearance and odor. Any drastic variation from the initial fluid specifications, such as a black or dark-gray color, presence of an oily layer, burnt odor, or any heavy sludge in the fluid may indicate the need for fluid replacement.



Dow Thermal Fluids Sampling Kit

PRODUCT PROPERTIES AND ENGINEERING

DATA FOR DOWTHERM FLUIDS

Data exhibits on pages 18 through 33 provide engineering properties for DOWTHERM SR-1 and DOWTHERM 4000 fluids. General information about film coefficients, pressure drop in pipes, and vapor pressure for DOWTHERM fluids is provided in the paragraphs below. Accompanying data for these properties begin on page 34. This information is useful to engineers, designers, operators, and maintenance personnel involved in solving problems related to heat transfer.

Film coefficients

Process heat transfer deals with transfer rates as they occur in engineering and chemical process equipment. The overall film or heat transfer coefficient (U) must be determined in the design process in order to evaluate the heat transfer surface required in the system. The overall heat transfer coefficient may be expressed by the following equation:

$$q = UA\Delta t_{LM}$$

The overall film coefficient is influenced by the fluid film heat transfer rates on each side of the tube (h_i and h_o), the resistance through the tube wall (r_w), and a fouling factor (r_f).

In terms of these individual factors, the following equation can be written:

$$1/U = 1/h_i + 1/h_o + r_w + r_f$$

If one film coefficient is small and the other very large, the smaller coefficient provides the major resistance to heat flow. The overall heat transfer coefficient for the equipment is then very nearly equal to the smaller or "controlling" film coefficient. In many applications where DOWTHERM heat transfer fluids are used, it is the material being heated or cooled that offers the major resistance to heat transfer. In such cases, the overall coefficient can be significantly increased only by increasing the film coefficient of that other material.

Dow calculates liquid film coefficients for solutions of DOWTHERM fluids using the Seider and Tate correlation equation:

$$Nu = 0.027 Re^{0.8} Pr^{0.33} (\mu/\mu_w)^{0.14}$$

Where,

$$Re = dG/\mu = dv\rho/\mu$$

$$Pr = C_p \mu/k$$

$$Nu = hd/k$$

These correlations are based on the assumption that:

$$(\mu/\mu_w)^{0.14} = 1$$

This correlation holds only for fully developed turbulent flow and should not be used for Reynolds numbers less than 10,000.

Film coefficients for DOWTHERM SR-1 and DOWTHERM 4000 fluids may be calculated using the equations provided here and the data for density, viscosity, thermal conductivity, and specific heat found in Tables 10 through 25.

Pressure drop

When a fluid flows over a surface, the pressure of the fluid decreases along the surface due to friction. This is called the pressure drop of the system. The Darcy equation for pressure drop of fluids in turbulent flow is:

$$\Delta P_{100} = 0.1294 f \rho v^2/d = 0.0216 f \rho Q^2/d^5$$

Values of f may be obtained from f versus Reynolds Number plots given in standard texts.

Figures 1 through 6 show pressure drop for various concentrations of ethylene glycol. Temperature correction factor data are also provided.

Vapor pressure

Tables 26 and 27 provide vapor pressure data for DOWTHERM SR-1 and DOWTHERM 4000 fluids.

Table 9 — Nomenclature and Symbols

		English Units	SI Units
A	Heat Transfer Surface Area.....	ft ²	m ²
C _p	Specific Heat.....	Btu/(lb•°F)	kJ/(kg•K)
d _b	Diameter	inch	cm
f	Friction Factor	dimensionless.....	
G	Mass Velocity.....	lb/(sec•ft ²)	kg/(sec•m ²)
h	Average Film Coefficient	Btu/(hr•ft ² •°F).....	W/(m ² •K)
k	Thermal Conductivity	Btu/(hr•ft ²)(°F/ft).....	W/(m•K)
Q	Flow Rate	gal/min	m ³ /sec
q	Heat Flow.....	Btu/hr	W
r	Tube Resistance	(hr•ft ² •°F)/Btu.....	m ² •K/W
U	Overall Heat Transfer Coefficient	Btu/(hr•ft ² •°F).....	W/(m ² •K)
v	Fluid Velocity.....	ft/sec	m/sec
Nu	Nusselt Number.....	dimensionless.....	
Pr	Prandtl Number.....	dimensionless.....	
ΔP	Pressure Drop	psi	kPa
Δt _{LM}	Log Mean Temperature Difference.....	°F	°C
μ	Viscosity (cps x 2.42 = lb/(hr•ft)).....	lb/(hr•ft).....	mPa•sec
ρ	Density	lb/ft ³	kg/m ³
Re	Reynolds Number (122.85 $\frac{Q\rho}{d\mu}$)	dimensionless.....	

Subscripts

f	fouling
i	inside
o	outside
w	wall

Table 10 — Densities (lb/ft³) of Aqueous Solutions of DOWTHERM SR-1 Fluid (lb/gal = 0.1337 x lb/ft³) – English Units

Temp. °F	Volume Percent Ethylene Glycol									
	0%	10%	20%	30%	40%	50%	60%	70%	80%	90%
-30							69.03	69.90	70.75	
-20						68.05	68.96	69.82	70.65	71.45
-10						67.98	68.87	69.72	70.54	71.33
0					66.97	67.90	68.78	69.62	70.43	71.20
10				65.93	66.89	67.80	68.67	69.50	70.30	71.06
20			64.83	65.85	66.80	67.70	68.56	69.38	70.16	70.92
30		63.69	64.75	65.76	66.70	67.59	68.44	69.25	70.02	70.76
40	62.42	63.61	64.66	65.66	66.59	67.47	68.31	69.10	69.86	70.59
50	62.38	63.52	64.56	65.55	66.47	67.34	68.17	68.95	69.70	70.42
60	62.34	63.42	64.45	65.43	66.34	67.20	68.02	68.79	69.53	70.23
70	62.27	63.31	64.33	65.30	66.20	67.05	67.86	68.62	69.35	70.04
80	62.19	63.19	64.21	65.17	66.05	66.90	67.69	68.44	69.15	69.83
90	62.11	63.07	64.07	65.02	65.90	66.73	67.51	68.25	68.95	69.62
100	62.00	62.93	63.93	64.86	65.73	66.55	67.32	68.05	68.74	69.40
110	61.84	62.79	63.77	64.70	65.56	66.37	67.13	67.84	68.52	69.17
120	61.73	62.63	63.61	64.52	65.37	66.17	66.92	67.63	68.29	68.92
130	61.54	62.47	63.43	64.34	65.18	65.97	66.71	67.40	68.05	68.67
140	61.39	62.30	63.25	64.15	64.98	65.75	66.48	67.16	67.81	68.41
150	61.20	62.11	63.06	63.95	64.76	65.53	66.25	66.92	67.55	68.14
160	61.01	61.92	62.86	63.73	64.54	65.30	66.00	66.66	67.28	67.86
170	60.79	61.72	62.64	63.51	64.31	65.05	65.75	66.40	67.01	67.58
180	60.57	61.51	62.42	63.28	64.07	64.80	65.49	66.12	66.72	67.28
190	60.35	61.29	62.19	63.04	63.82	64.54	65.21	65.84	66.42	66.97
200	60.13	61.06	61.95	62.79	63.56	64.27	64.93	65.55	66.12	66.65
210	59.88	60.82	61.71	62.53	63.29	63.99	64.64	65.24	65.81	66.33
220	59.63	60.57	61.45	62.27	63.01	63.70	64.34	64.93	65.48	65.99
230	59.38	60.31	61.18	61.99	62.72	63.40	64.03	64.61	65.15	65.65
240	59.10	60.05	60.90	61.70	62.43	63.10	63.71	64.28	64.81	65.29
250	58.82	59.77	60.62	61.40	62.12	62.78	63.39	63.94	64.46	64.93

= Above atmospheric boiling point

NOTE: To determine specific gravity, divide the density of the fluid by the density of water at 68°F.

Table 11 — Densities (kg/m³) of Aqueous Solutions of DOWTHERM SR-1 Fluid—SI Units


Temp. °C	Volume Percent Ethylene Glycol									
	0%	10%	20%	30%	40%	50%	60%	70%	80%	90%
-35							1105.8	1119.9	1133.4	
-30						1090.3	1104.8	1118.6	1132.0	1144.8
-25					1074.2	1089.2	1103.6	1117.3	1130.5	1143.2
-20					1073.2	1088.1	1102.3	1115.8	1128.8	1141.3
-15				1056.6	1072.1	1086.8	1100.9	1114.2	1127.1	1139.4
-10				1055.5	1070.8	1085.4	1099.3	1112.5	1125.2	1137.4
-5			1038.0	1054.3	1069.5	1083.9	1097.7	1110.7	1123.2	1135.2
0		1019.9	1036.8	1053.0	1068.0	1082.3	1095.9	1108.7	1121.1	1132.9
5	1006.7	1018.7	1035.5	1051.5	1066.4	1080.5	1094.0	1106.7	1118.8	1130.5
10	1004.3	1017.4	1034.1	1049.9	1064.7	1078.7	1091.9	1104.5	1116.5	1127.9
15	1001.9	1016.0	1032.5	1048.2	1062.8	1076.7	1089.8	1102.2	1114.0	1125.3
20	999.4	1014.5	1030.9	1046.4	1060.9	1074.5	1087.5	1099.7	1111.4	1122.5
25	996.9	1012.8	1029.1	1044.5	1058.8	1072.3	1085.1	1097.1	1108.6	1119.6
30	994.3	1011.0	1027.2	1042.4	1056.6	1069.9	1082.6	1094.5	1105.8	1116.6
35	991.7	1009.2	1025.1	1040.2	1054.2	1067.5	1079.9	1091.7	1102.8	1113.4
40	989.0	1007.1	1023.0	1037.9	1051.8	1064.9	1077.2	1088.7	1099.7	1110.1
45	986.3	1005.0	1020.7	1035.5	1049.2	1062.1	1074.3	1085.7	1096.5	1106.7
50	983.5	1002.7	1018.3	1033.0	1046.5	1059.3	1071.3	1082.5	1093.2	1103.2
55	980.7	1000.3	1015.8	1030.3	1043.7	1056.3	1068.1	1079.2	1089.7	1099.6
60	977.8	997.8	1013.1	1027.5	1040.8	1053.2	1064.9	1075.8	1086.1	1095.8
65	974.9	995.2	1010.4	1024.6	1037.7	1050.0	1061.5	1072.3	1082.4	1092.0
70	971.9	992.5	1007.5	1021.6	1034.5	1046.7	1058.0	1068.6	1078.6	1088.0
75	968.8	989.6	1004.5	1018.4	1031.2	1043.2	1054.4	1064.8	1074.6	1083.8
80	965.7	986.6	1001.3	1015.1	1027.8	1039.6	1050.7	1060.9	1070.6	1079.6
85	962.6	983.5	998.1	1011.7	1024.3	1035.9	1046.8	1056.9	1066.4	1075.2
90	959.3	980.3	994.7	1008.2	1020.6	1032.1	1042.8	1052.8	1062.1	1070.7
95	956.0	976.9	991.2	1004.6	1016.8	1028.2	1038.7	1048.5	1057.6	1066.1
100	952.6	973.4	987.6	1000.8	1012.9	1024.1	1034.5	1044.1	1053.1	1061.4
105	949.2	969.8	983.9	996.9	1008.8	1019.9	1030.1	1039.6	1048.4	1056.5
110	945.7	966.1	980.0	992.9	1004.7	1015.6	1025.7	1035.0	1043.6	1051.6
115	942.1	962.2	976.0	988.8	1000.4	1011.2	1021.1	1030.2	1038.7	1046.5
120	938.5	958.3	971.9	984.5	996.0	1006.6	1016.4	1025.3	1033.6	1041.2

■ = At or above atmospheric boiling point

NOTE: To determine specific gravity, divide the density of the fluid by the density of water at 20°C.

Table 12 — Densities (lb/ft³) of Aqueous Solutions of DOWTHERM 4000 Fluid (lb/gal = 0.1337 x lb/ft³) – English Units

Temp. °F	Volume Percent Ethylene Glycol									
	0%	10%	20%	30%	40%	50%	60%	70%	80%	90%
-30							70.40	71.33	72.19	
-20						69.26	70.26	71.17	72.02	72.82
-10						69.12	70.10	71.01	71.85	72.63
0					67.93	68.97	69.94	70.84	71.67	72.45
10				66.68	67.79	68.82	69.78	70.66	71.49	72.26
20			65.36	66.55	67.64	68.66	69.60	70.48	71.30	72.06
30		63.97	65.23	66.41	67.49	68.49	69.43	70.29	71.10	71.86
40	62.42	63.86	65.10	66.27	67.33	68.32	69.24	70.10	70.90	71.65
50	62.38	63.74	64.97	66.11	67.17	68.14	69.06	69.90	70.70	71.44
60	62.34	63.62	64.83	65.96	66.99	67.96	68.86	69.70	70.48	71.22
70	62.27	63.49	64.68	65.79	66.82	67.77	68.66	69.49	70.27	70.99
80	62.19	63.35	64.52	65.62	66.63	67.58	68.46	69.28	70.05	70.77
90	62.11	63.21	64.36	65.45	66.44	67.38	68.25	69.06	69.82	70.53
100	62.00	63.06	64.20	65.27	66.25	67.17	68.03	68.83	69.59	70.29
110	61.84	62.90	64.03	65.08	66.05	66.96	67.81	68.60	69.35	70.05
120	61.73	62.74	63.85	64.88	65.84	66.74	67.58	68.36	69.10	69.80
130	61.54	62.58	63.66	64.68	65.63	66.51	67.34	68.12	68.85	69.55
140	61.39	62.40	63.47	64.48	65.41	66.28	67.10	67.87	68.60	69.29
150	61.20	62.22	63.27	64.27	65.18	66.05	66.86	67.62	68.34	69.02
160	61.01	62.04	63.07	64.05	64.95	65.80	66.61	67.36	68.08	68.75
170	60.79	61.84	62.86	63.82	64.72	65.56	66.35	67.10	67.81	68.48
180	60.57	61.64	62.65	63.59	64.47	65.30	66.09	66.83	67.53	68.20
190	60.35	61.44	62.42	63.36	64.22	65.04	65.82	66.55	67.25	67.91
200	60.13	61.23	62.20	63.11	63.97	64.78	65.54	66.27	66.96	67.62
210	59.88	61.01	61.96	62.87	63.71	64.51	65.27	65.98	66.67	67.33
220	59.63	60.79	61.72	62.61	63.44	64.23	64.98	65.69	66.37	67.03
230	59.38	60.56	61.48	62.35	63.17	63.95	64.69	65.39	66.07	66.72
240	59.10	60.32	61.22	62.08	62.89	63.66	64.39	65.09	65.76	66.41
250	58.82	60.08	60.97	61.81	62.60	63.36	64.09	64.78	65.45	66.10
260	58.51	59.83	60.70	61.53	62.31	63.06	63.78	64.47	65.13	65.78
270	58.24	59.58	60.43	61.25	62.02	62.76	63.47	64.15	64.81	65.45
280	57.94	59.32	60.15	60.96	61.71	62.44	63.15	63.82	64.48	65.12
290	57.64	59.05	59.87	60.66	61.41	62.13	62.82	63.49	64.15	64.78
300	57.31	58.78	59.58	60.36	61.09	61.80	62.49	63.16	63.81	64.44
310	56.98	58.50	59.29	60.05	60.77	61.47	62.15	62.81	63.46	64.09
320	56.66	58.22	58.98	59.73	60.44	61.14	61.81	62.47	63.11	63.74
330	56.30	57.93	58.68	59.41	60.11	60.80	61.46	62.11	62.75	63.38
340	55.96	57.63	58.36	59.08	59.77	60.45	61.11	61.76	62.39	63.02
350	55.59	57.32	58.04	58.75	59.43	60.10	60.75	61.39	62.03	62.66

 = Above atmospheric boiling point

NOTE: To determine specific gravity, divide the density of the fluid by the density of water at 68°F.

Table 13 — Densities (kg/m³) of Aqueous Solutions of DOWTHERM 4000 Fluid—SI Units

Temp. °C	Volume Percent Ethylene Glycol									
	0%	10%	20%	30%	40%	50%	60%	70%	80%	90%
-35							1128.0	1142.8	1156.6	
-30						1109.9	1125.8	1140.5	1154.2	1167.0
-25					1090.9	1107.9	1123.6	1138.2	1151.7	1164.3
-20					1089.0	1105.8	1121.3	1135.8	1149.2	1161.7
-15				1069.2	1087.0	1103.6	1119.0	1133.3	1146.6	1158.9
-10				1067.3	1084.9	1101.3	1116.6	1130.7	1143.9	1156.1
-5			1046.3	1065.3	1082.8	1099.0	1114.1	1128.0	1141.1	1153.3
0		1024.3	1044.5	1063.3	1080.5	1096.6	1111.5	1125.3	1138.3	1150.3
5	1006.7	1022.7	1042.6	1061.2	1078.2	1094.1	1108.9	1122.6	1135.4	1147.3
10	1004.3	1021.0	1040.6	1059.0	1075.8	1091.5	1106.1	1119.7	1132.4	1144.2
15	1001.9	1019.2	1038.6	1056.8	1073.4	1088.9	1103.3	1116.8	1129.3	1141.1
20	999.4	1017.4	1036.5	1054.4	1070.8	1086.2	1100.5	1113.8	1126.2	1137.9
25	996.9	1015.4	1034.3	1052.0	1068.2	1083.4	1097.5	1110.7	1123.1	1134.6
30	994.3	1013.4	1032.0	1049.5	1065.5	1080.5	1094.5	1107.6	1119.8	1131.3
35	991.7	1011.3	1029.7	1046.9	1062.7	1077.6	1091.4	1104.3	1116.5	1127.9
40	989.0	1009.1	1027.2	1044.2	1059.9	1074.6	1088.3	1101.1	1113.1	1124.4
45	986.3	1006.8	1024.7	1041.5	1057.0	1071.5	1085.0	1097.7	1109.6	1120.9
50	983.5	1004.5	1022.1	1038.7	1054.0	1068.3	1081.7	1094.3	1106.1	1117.3
55	980.7	1002.0	1019.4	1035.8	1050.9	1065.0	1078.3	1090.8	1102.5	1113.6
60	977.8	999.5	1016.7	1032.8	1047.7	1061.7	1074.9	1087.2	1098.8	1109.8
65	974.9	997.0	1013.8	1029.8	1044.5	1058.3	1071.3	1083.5	1095.1	1106.0
70	971.9	994.3	1010.9	1026.6	1041.2	1054.8	1067.7	1079.8	1091.3	1102.2
75	968.8	991.5	1007.9	1023.4	1037.8	1051.3	1064.0	1076.0	1087.4	1098.2
80	965.7	988.7	1004.9	1020.1	1034.3	1047.7	1060.3	1072.2	1083.5	1094.2
85	962.6	985.8	1001.7	1016.8	1030.7	1044.0	1056.4	1068.2	1079.5	1090.1
90	959.3	982.8	998.5	1013.3	1027.1	1040.2	1052.5	1064.2	1075.4	1086.0
95	956.0	979.7	995.2	1009.8	1023.4	1036.3	1048.6	1060.1	1071.2	1081.8
100	952.6	976.6	991.8	1006.2	1019.6	1032.4	1044.5	1056.0	1067.0	1077.5
105	949.2	973.4	988.3	1002.5	1015.8	1028.4	1040.4	1051.8	1062.7	1073.2
110	945.7	970.0	984.7	998.7	1011.8	1024.3	1036.2	1047.5	1058.3	1068.8
115	942.1	966.7	981.1	994.9	1007.8	1020.1	1031.9	1043.1	1053.9	1064.3
120	938.5	963.2	977.4	991.0	1003.7	1015.9	1027.6	1038.7	1049.4	1059.8
125	934.7	959.6	973.6	987.0	999.6	1011.6	1023.1	1034.2	1044.8	1055.1
130	930.9	956.0	969.7	982.9	995.3	1007.2	1018.6	1029.6	1040.2	1050.5
135	927.1	952.3	965.8	978.7	991.0	1002.7	1014.1	1024.9	1035.5	1045.7
140	923.1	948.5	961.7	974.5	986.6	998.2	1009.4	1020.2	1030.7	1040.9
145	919.1	944.6	957.6	970.2	982.1	993.6	1004.7	1015.4	1025.9	1036.0
150	914.9	940.7	953.4	965.8	977.5	988.9	999.9	1010.5	1020.9	1031.1
155	910.7	936.6	949.2	961.3	972.9	984.1	995.0	1005.6	1015.9	1026.1
160	906.4	932.5	944.8	956.8	968.2	979.3	990.1	1000.6	1010.9	1021.0
165	902.0	928.3	940.4	952.1	963.4	974.4	985.1	995.5	1005.8	1015.9
170	897.5	924.0	935.9	947.4	958.5	969.4	980.0	990.3	1000.6	1010.7
175	892.9	919.7	931.3	942.7	953.6	964.3	974.8	985.1	995.3	1005.4

At or above atmospheric boiling point

NOTE: To determine specific gravity, divide the density of the fluid by the density of water at 20°C.

Table 14 — Viscosities (cps) of Aqueous Solutions of DOWTHERM SR-1 Fluid—English Units

Temp. °F	Volume Percent Ethylene Glycol									
	0%	10%	20%	30%	40%	50%	60%	70%	80%	90%
-30							89.67	128.79	185.22	
-20						40.38	60.46	89.93	131.32	284.48
-10						27.27	42.05	63.50	91.88	169.83
0					13.76	19.34	30.08	45.58	65.04	107.77
10				6.83	10.13	14.26	22.06	33.31	46.89	71.87
20			3.90	5.38	7.74	10.85	16.56	24.79	34.48	49.94
30		2.16	3.14	4.33	6.09	8.48	12.68	18.77	25.84	35.91
40	1.53	1.82	2.59	3.54	4.91	6.77	9.90	14.45	19.71	26.59
50	1.30	1.56	2.18	2.95	4.04	5.50	7.85	11.31	15.29	20.18
60	1.12	1.35	1.86	2.49	3.38	4.55	6.33	8.97	12.05	15.65
70	0.98	1.18	1.61	2.13	2.87	3.81	5.17	7.22	9.62	12.37
80	0.86	1.04	1.41	1.84	2.46	3.23	4.28	5.88	7.79	9.93
90	0.76	0.93	1.24	1.60	2.13	2.76	3.58	4.85	6.38	8.10
100	0.68	0.83	1.11	1.41	1.87	2.39	3.03	4.04	5.28	6.68
110	0.61	0.75	0.99	1.25	1.64	2.08	2.58	3.40	4.41	5.58
120	0.55	0.68	0.90	1.11	1.46	1.82	2.23	2.88	3.73	4.71
130	0.51	0.62	0.81	1.00	1.30	1.61	1.93	2.47	3.17	4.01
140	0.46	0.57	0.74	0.90	1.17	1.43	1.69	2.13	2.72	3.45
150	0.43	0.53	0.68	0.82	1.05	1.28	1.49	1.86	2.35	2.98
160	0.39	0.49	0.63	0.75	0.95	1.15	1.32	1.63	2.05	2.60
170	0.37	0.46	0.58	0.68	0.87	1.04	1.18	1.43	1.80	2.28
180	0.34	0.43	0.54	0.63	0.79	0.94	1.06	1.27	1.58	2.01
190	0.32	0.40	0.50	0.58	0.73	0.85	0.95	1.14	1.40	1.79
200	0.30	0.37	0.47	0.54	0.67	0.78	0.86	1.02	1.25	1.60
210	0.28	0.35	0.43	0.50	0.61	0.71	0.78	0.92	1.12	1.43
220	0.27	0.33	0.41	0.46	0.57	0.66	0.72	0.83	1.01	1.29
230	0.25	0.32	0.38	0.43	0.53	0.60	0.66	0.76	0.91	1.16
240	0.24	0.30	0.36	0.40	0.49	0.56	0.61	0.69	0.83	1.06
250	0.23	0.29	0.34	0.38	0.45	0.52	0.56	0.63	0.75	0.96


 = Above atmospheric boiling point

Table 15 — Viscosities (mPa sec) of Aqueous Solutions of DOWTHERM SR-1 Fluid—SI Units

Temp. °C	Volume Percent Ethylene Glycol									
	0%	10%	20%	30%	40%	50%	60%	70%	80%	90%
-35							93.44	133.53	191.09	
-30						43.98	65.25	96.57	141.02	318.12
-25					22.01	30.50	46.75	70.38	102.21	196.87
-20					15.75	22.07	34.28	51.94	74.53	128.43
-15				7.77	11.74	16.53	25.69	38.88	55.09	87.52
-10				6.19	9.06	12.74	19.62	29.53	41.36	61.85
-5			3.65	5.03	7.18	10.05	15.25	22.76	31.56	45.08
0		2.08	3.02	4.15	5.83	8.09	12.05	17.79	24.44	33.74
5	1.51	1.79	2.54	3.48	4.82	6.63	9.66	14.09	19.20	25.84
10	1.30	1.56	2.18	2.95	4.04	5.50	7.85	11.31	15.29	20.18
15	1.14	1.37	1.89	2.53	3.44	4.63	6.46	9.18	12.33	16.04
20	1.00	1.21	1.65	2.20	2.96	3.94	5.38	7.53	10.05	12.95
25	0.89	1.08	1.46	1.92	2.57	3.39	4.52	6.24	8.29	10.59
30	0.79	0.97	1.30	1.69	2.26	2.94	3.84	5.23	6.90	8.77
35	0.72	0.88	1.17	1.50	1.99	2.56	3.29	4.42	5.79	7.34
40	0.65	0.80	1.06	1.34	1.77	2.26	2.84	3.76	4.91	6.21
45	0.59	0.73	0.96	1.21	1.59	2.00	2.47	3.23	4.19	5.30
50	0.54	0.67	0.88	1.09	1.43	1.78	2.16	2.80	3.61	4.56
55	0.50	0.62	0.81	0.99	1.29	1.59	1.91	2.43	3.12	3.95
60	0.46	0.57	0.74	0.90	1.17	1.43	1.69	2.13	2.72	3.45
65	0.43	0.53	0.69	0.83	1.06	1.29	1.51	1.88	2.39	3.03
70	0.40	0.50	0.64	0.76	0.97	1.17	1.35	1.67	2.11	2.67
75	0.37	0.47	0.59	0.70	0.89	1.07	1.22	1.49	1.87	2.37
80	0.35	0.44	0.55	0.65	0.82	0.98	1.10	1.33	1.66	2.12
85	0.33	0.41	0.52	0.60	0.76	0.89	1.00	1.20	1.49	1.90
90	0.31	0.39	0.49	0.56	0.70	0.82	0.92	1.09	1.34	1.71
95	0.29	0.37	0.46	0.52	0.65	0.76	0.84	0.99	1.21	1.54
100	0.28	0.35	0.43	0.49	0.60	0.70	0.77	0.90	1.10	1.40
105	0.27	0.33	0.40	0.46	0.56	0.65	0.71	0.82	1.00	1.27
110	0.25	0.32	0.38	0.43	0.53	0.60	0.66	0.76	0.91	1.16
115	0.24	0.30	0.36	0.41	0.49	0.56	0.61	0.70	0.83	1.07
120	0.23	0.29	0.34	0.38	0.46	0.53	0.57	0.64	0.77	0.98


 = At or above atmospheric boiling point

Table 16 — Viscosities (cps) of Aqueous Solutions of DOWTHERM 4000 Fluid—English Units


Temp. °F	Volume Percent Ethylene Glycol									
	0%	10%	20%	30%	40%	50%	60%	70%	80%	90%
-30							89.67	128.79	185.22	
-20						40.38	60.46	89.93	131.32	284.48
-10						27.27	42.05	63.50	91.88	169.83
0					13.76	19.34	30.08	45.58	65.04	107.77
10				6.83	10.13	14.26	22.06	33.31	46.89	71.87
20			3.90	5.38	7.74	10.85	16.56	24.79	34.48	49.94
30		2.16	3.14	4.33	6.09	8.48	12.68	18.77	25.84	35.91
40	1.53	1.82	2.59	3.54	4.91	6.77	9.90	14.45	19.71	26.59
50	1.30	1.56	2.18	2.95	4.04	5.50	7.85	11.31	15.29	20.18
60	1.12	1.35	1.86	2.49	3.38	4.55	6.33	8.97	12.05	15.65
70	0.98	1.18	1.61	2.13	2.87	3.81	5.17	7.22	9.62	12.37
80	0.86	1.04	1.41	1.84	2.46	3.23	4.28	5.88	7.79	9.93
90	0.76	0.93	1.24	1.60	2.13	2.76	3.58	4.85	6.38	8.10
100	0.68	0.83	1.11	1.41	1.87	2.39	3.03	4.04	5.28	6.68
110	0.61	0.75	0.99	1.25	1.64	2.08	2.58	3.40	4.41	5.58
120	0.55	0.68	0.90	1.11	1.46	1.82	2.23	2.88	3.73	4.71
130	0.51	0.62	0.81	1.00	1.30	1.61	1.93	2.47	3.17	4.01
140	0.46	0.57	0.74	0.90	1.17	1.43	1.69	2.13	2.72	3.45
150	0.43	0.53	0.68	0.82	1.05	1.28	1.49	1.86	2.35	2.98
160	0.39	0.49	0.63	0.75	0.95	1.15	1.32	1.63	2.05	2.60
170	0.37	0.46	0.58	0.68	0.87	1.04	1.18	1.43	1.80	2.28
180	0.34	0.43	0.54	0.63	0.79	0.94	1.06	1.27	1.58	2.01
190	0.32	0.40	0.50	0.58	0.73	0.85	0.95	1.14	1.40	1.79
200	0.30	0.37	0.47	0.54	0.67	0.78	0.86	1.02	1.25	1.60
210	0.28	0.35	0.43	0.50	0.61	0.71	0.78	0.92	1.12	1.43
220	0.26	0.33	0.41	0.46	0.57	0.66	0.72	0.83	1.01	1.29
230	0.25	0.32	0.38	0.43	0.53	0.60	0.66	0.76	0.91	1.16
240	0.24	0.30	0.36	0.40	0.49	0.56	0.61	0.69	0.83	1.06
250	0.23	0.29	0.34	0.38	0.45	0.52	0.56	0.63	0.75	0.96
260	0.22	0.27	0.32	0.36	0.42	0.48	0.52	0.58	0.69	0.88
270	0.21	0.26	0.30	0.34	0.40	0.45	0.48	0.54	0.63	0.81
280	0.20	0.25	0.29	0.32	0.37	0.42	0.45	0.50	0.58	0.74
290	0.19	0.24	0.27	0.30	0.35	0.39	0.42	0.46	0.53	0.69
300	0.18	0.23	0.26	0.29	0.33	0.37	0.39	0.43	0.50	0.63
310	0.18	0.22	0.25	0.27	0.31	0.34	0.37	0.40	0.46	0.59
320	0.17	0.21	0.23	0.26	0.29	0.32	0.35	0.38	0.43	0.55
330	0.16	0.21	0.22	0.25	0.28	0.30	0.33	0.35	0.40	0.51
340	0.16	0.20	0.21	0.24	0.26	0.29	0.31	0.33	0.37	0.48
350	0.15	0.19	0.20	0.23	0.25	0.27	0.29	0.31	0.35	0.45

= Above atmospheric boiling point

NOTE: To determine specific gravity, divide the density of the fluid by the density of water at 68°F.

Table 17 — Viscosities (mPa sec) of Aqueous Solutions of DOWTHERM 4000 Fluid—SI Units

Temp. °C	Volume Percent Ethylene Glycol									
	0%	10%	20%	30%	40%	50%	60%	70%	80%	90%
-35							93.44	133.53	191.09	
-30						43.98	65.25	96.57	141.02	318.12
-25					22.01	30.50	46.75	70.38	102.21	196.87
-20					15.75	22.07	34.28	51.94	74.53	128.43
-15				7.77	11.74	16.53	25.69	38.88	55.09	87.52
-10				6.19	9.06	12.74	19.62	29.53	41.36	61.85
-5			3.65	5.03	7.18	10.05	15.25	22.76	31.56	45.08
0		2.08	3.02	4.15	5.83	8.09	12.05	17.79	24.44	33.74
5	1.51	1.79	2.54	3.48	4.82	6.63	9.66	14.09	19.20	25.84
10	1.30	1.56	2.18	2.95	4.04	5.50	7.85	11.31	15.29	20.18
15	1.14	1.37	1.89	2.53	3.44	4.63	6.46	9.18	12.33	16.04
20	1.00	1.21	1.65	2.20	2.96	3.94	5.38	7.53	10.05	12.95
25	0.89	1.08	1.46	1.92	2.57	3.39	4.52	6.24	8.29	10.59
30	0.79	0.97	1.30	1.69	2.26	2.94	3.84	5.23	6.90	8.77
35	0.72	0.88	1.17	1.50	1.99	2.56	3.29	4.42	5.79	7.34
40	0.65	0.80	1.06	1.34	1.77	2.26	2.84	3.76	4.91	6.21
45	0.59	0.73	0.96	1.21	1.59	2.00	2.47	3.23	4.19	5.30
50	0.54	0.67	0.88	1.09	1.43	1.78	2.16	2.80	3.61	4.56
55	0.50	0.62	0.81	0.99	1.29	1.59	1.91	2.43	3.12	3.95
60	0.46	0.57	0.74	0.90	1.17	1.43	1.69	2.13	2.72	3.45
65	0.43	0.53	0.69	0.83	1.06	1.29	1.51	1.88	2.39	3.03
70	0.40	0.50	0.64	0.76	0.97	1.17	1.35	1.67	2.11	2.67
75	0.37	0.47	0.59	0.70	0.89	1.07	1.22	1.49	1.87	2.37
80	0.35	0.44	0.55	0.65	0.82	0.98	1.10	1.33	1.66	2.12
85	0.33	0.41	0.52	0.60	0.76	0.89	1.00	1.20	1.49	1.90
90	0.31	0.39	0.49	0.56	0.70	0.82	0.92	1.09	1.34	1.71
95	0.29	0.37	0.46	0.52	0.65	0.76	0.84	0.99	1.21	1.54
100	0.28	0.35	0.43	0.49	0.60	0.70	0.77	0.90	1.10	1.40
105	0.27	0.33	0.40	0.46	0.56	0.65	0.71	0.82	1.00	1.27
110	0.25	0.32	0.38	0.43	0.53	0.60	0.66	0.76	0.91	1.16
115	0.24	0.30	0.36	0.41	0.49	0.56	0.61	0.70	0.83	1.07
120	0.23	0.29	0.34	0.38	0.46	0.53	0.57	0.64	0.77	0.98
125	0.22	0.28	0.33	0.36	0.43	0.49	0.53	0.60	0.71	0.90
130	0.21	0.26	0.31	0.35	0.41	0.46	0.50	0.55	0.65	0.84
135	0.20	0.25	0.29	0.33	0.38	0.43	0.46	0.52	0.60	0.77
140	0.19	0.25	0.28	0.31	0.36	0.41	0.44	0.48	0.56	0.72
145	0.18	0.24	0.27	0.30	0.34	0.38	0.41	0.45	0.52	0.67
150	0.18	0.23	0.26	0.28	0.32	0.36	0.39	0.42	0.49	0.62
155	0.17	0.22	0.25	0.27	0.31	0.34	0.37	0.40	0.46	0.58
160	0.16	0.21	0.23	0.26	0.29	0.32	0.35	0.38	0.43	0.55
165	0.16	0.21	0.23	0.25	0.28	0.31	0.33	0.36	0.40	0.51
170	0.15	0.20	0.22	0.24	0.26	0.29	0.31	0.34	0.38	0.48
175	0.15	0.19	0.21	0.23	0.25	0.28	0.30	0.32	0.36	0.45

 = At or above atmospheric boiling point

**Table 18 — Thermal Conductivity (Btu/(hr·ft²)(°F/ft))
of Aqueous Solutions of DOWTHERM SR-1 Fluid—English Units**

Temp. °F	Volume Percent Ethylene Glycol									
	0%	10%	20%	30%	40%	50%	60%	70%	80%	90%
-30							0.173	0.161	0.151	
-20							0.175	0.163	0.153	0.145
-10						0.192	0.178	0.165	0.154	0.146
0					0.213	0.195	0.180	0.166	0.155	0.147
10				0.236	0.216	0.198	0.182	0.168	0.156	0.148
20			0.263	0.240	0.219	0.200	0.184	0.170	0.158	0.148
30		0.294	0.268	0.244	0.222	0.203	0.186	0.171	0.159	0.149
40	0.330	0.300	0.273	0.248	0.225	0.205	0.188	0.172	0.160	0.150
50	0.336	0.305	0.277	0.251	0.228	0.208	0.190	0.174	0.161	0.151
60	0.342	0.310	0.281	0.255	0.231	0.210	0.191	0.175	0.162	0.151
70	0.347	0.314	0.285	0.258	0.234	0.212	0.193	0.177	0.163	0.152
80	0.352	0.319	0.289	0.261	0.236	0.214	0.195	0.178	0.164	0.153
90	0.357	0.323	0.292	0.264	0.239	0.216	0.196	0.179	0.164	0.153
100	0.362	0.327	0.296	0.267	0.241	0.218	0.198	0.180	0.165	0.154
110	0.366	0.331	0.299	0.269	0.243	0.220	0.199	0.181	0.166	0.154
120	0.370	0.334	0.301	0.272	0.245	0.221	0.200	0.182	0.167	0.155
130	0.374	0.337	0.304	0.274	0.247	0.223	0.201	0.183	0.167	0.155
140	0.377	0.340	0.306	0.276	0.248	0.224	0.202	0.183	0.168	0.156
150	0.380	0.342	0.309	0.277	0.250	0.225	0.203	0.184	0.168	0.156
160	0.383	0.345	0.310	0.279	0.251	0.226	0.204	0.185	0.169	0.156
170	0.385	0.347	0.312	0.280	0.252	0.227	0.204	0.185	0.169	0.157
180	0.387	0.348	0.314	0.282	0.253	0.228	0.205	0.186	0.169	0.157
190	0.389	0.350	0.315	0.283	0.254	0.228	0.206	0.186	0.170	0.157
200	0.391	0.351	0.316	0.284	0.255	0.229	0.206	0.186	0.170	0.157
210	0.392	0.352	0.317	0.284	0.255	0.229	0.206	0.186	0.170	0.157
220	0.393	0.353	0.318	0.285	0.256	0.230	0.207	0.187	0.170	0.157
230	0.394	0.354	0.318	0.285	0.256	0.230	0.207	0.187	0.170	0.157
240	0.395	0.355	0.319	0.286	0.256	0.230	0.207	0.187	0.170	0.157
250	0.395	0.355	0.319	0.286	0.257	0.230	0.207	0.187	0.170	0.157

= Above atmospheric boiling point

Table 19 — Thermal Conductivity (W/mK) of Aqueous Solutions of DOWTHERM SR-1 – SI Units

Temp. °C	Volume Percent Ethylene Glycol									
	0%	10%	20%	30%	40%	50%	60%	70%	80%	90%
-35							0.300	0.279	0.262	
-30						0.328	0.303	0.282	0.264	0.250
-25					0.361	0.332	0.306	0.284	0.266	0.252
-20					0.366	0.336	0.310	0.287	0.268	0.253
-15				0.405	0.371	0.340	0.313	0.289	0.270	0.255
-10				0.411	0.376	0.344	0.316	0.292	0.272	0.256
-5			0.458	0.417	0.381	0.348	0.319	0.294	0.273	0.257
0		0.512	0.466	0.423	0.386	0.352	0.322	0.297	0.275	0.259
5	0.572	0.520	0.472	0.429	0.391	0.356	0.325	0.299	0.277	0.260
10	0.582	0.528	0.479	0.435	0.395	0.360	0.328	0.301	0.278	0.261
15	0.591	0.535	0.486	0.440	0.400	0.363	0.331	0.303	0.280	0.262
20	0.599	0.543	0.492	0.445	0.404	0.367	0.334	0.305	0.281	0.263
25	0.608	0.550	0.498	0.450	0.408	0.370	0.336	0.307	0.283	0.264
30	0.615	0.556	0.503	0.455	0.412	0.373	0.338	0.309	0.284	0.265
35	0.623	0.563	0.509	0.459	0.415	0.376	0.341	0.311	0.285	0.266
40	0.630	0.569	0.514	0.463	0.419	0.378	0.343	0.312	0.286	0.267
45	0.636	0.574	0.518	0.467	0.422	0.381	0.345	0.314	0.288	0.268
50	0.642	0.579	0.523	0.471	0.425	0.383	0.347	0.315	0.289	0.268
55	0.648	0.584	0.527	0.474	0.427	0.385	0.348	0.316	0.289	0.269
60	0.653	0.588	0.530	0.477	0.430	0.387	0.350	0.317	0.290	0.270
65	0.657	0.592	0.534	0.480	0.432	0.389	0.351	0.318	0.291	0.270
70	0.662	0.596	0.537	0.483	0.434	0.391	0.352	0.319	0.292	0.271
75	0.666	0.599	0.539	0.485	0.436	0.392	0.354	0.320	0.292	0.271
80	0.669	0.602	0.542	0.487	0.438	0.394	0.355	0.321	0.293	0.271
85	0.672	0.605	0.544	0.489	0.439	0.395	0.355	0.322	0.293	0.271
90	0.675	0.607	0.546	0.490	0.440	0.396	0.356	0.322	0.294	0.272
95	0.677	0.609	0.548	0.491	0.441	0.396	0.357	0.322	0.294	0.272
100	0.679	0.610	0.549	0.493	0.442	0.397	0.357	0.323	0.294	0.272
105	0.681	0.612	0.550	0.493	0.443	0.398	0.358	0.323	0.294	0.272
110	0.682	0.613	0.551	0.494	0.443	0.398	0.358	0.323	0.294	0.272
115	0.683	0.614	0.552	0.495	0.444	0.398	0.358	0.323	0.294	0.272
120	0.684	0.614	0.552	0.495	0.444	0.398	0.358	0.323	0.294	0.272

 = At or above atmospheric boiling point

Table 20 — Thermal Conductivity (Btu/hr ft²(°F/ft)) of Aqueous Solutions of DOWTHERM 4000 Fluid—English Units

Temp. °F	Volume Percent Ethylene Glycol									
	0%	10%	20%	30%	40%	50%	60%	70%	80%	90%
-30							0.173	0.161	0.151	
-20							0.175	0.163	0.153	0.145
-10						0.192	0.178	0.165	0.154	0.146
0					0.213	0.195	0.180	0.166	0.155	0.147
10				0.236	0.216	0.198	0.182	0.168	0.156	0.148
20			0.263	0.240	0.219	0.200	0.184	0.170	0.158	0.148
30		0.294	0.268	0.244	0.222	0.203	0.186	0.171	0.159	0.149
40	0.330	0.300	0.273	0.248	0.225	0.205	0.188	0.172	0.160	0.150
50	0.336	0.305	0.277	0.251	0.228	0.208	0.190	0.174	0.161	0.151
60	0.342	0.310	0.281	0.255	0.231	0.210	0.191	0.175	0.162	0.151
70	0.347	0.314	0.285	0.258	0.234	0.212	0.193	0.177	0.163	0.152
80	0.352	0.319	0.289	0.261	0.236	0.214	0.195	0.178	0.164	0.153
90	0.357	0.323	0.292	0.264	0.239	0.216	0.196	0.179	0.164	0.153
100	0.362	0.327	0.296	0.267	0.241	0.218	0.198	0.180	0.165	0.154
110	0.366	0.331	0.299	0.269	0.243	0.220	0.199	0.181	0.166	0.154
120	0.370	0.334	0.301	0.272	0.245	0.221	0.200	0.182	0.167	0.155
130	0.374	0.337	0.304	0.274	0.247	0.223	0.201	0.183	0.167	0.155
140	0.377	0.340	0.306	0.276	0.248	0.224	0.202	0.183	0.168	0.156
150	0.380	0.342	0.309	0.277	0.250	0.225	0.203	0.184	0.168	0.156
160	0.383	0.345	0.310	0.279	0.251	0.226	0.204	0.185	0.169	0.156
170	0.385	0.347	0.312	0.280	0.252	0.227	0.204	0.185	0.169	0.157
180	0.387	0.348	0.314	0.282	0.253	0.228	0.205	0.186	0.169	0.157
190	0.389	0.350	0.315	0.283	0.254	0.228	0.206	0.186	0.170	0.157
200	0.391	0.351	0.316	0.284	0.255	0.229	0.206	0.186	0.170	0.157
210	0.392	0.352	0.317	0.284	0.255	0.229	0.206	0.186	0.170	0.157
220	0.393	0.353	0.318	0.285	0.256	0.230	0.207	0.187	0.170	0.157
230	0.394	0.354	0.318	0.285	0.256	0.230	0.207	0.187	0.170	0.157
240	0.395	0.355	0.319	0.286	0.256	0.230	0.207	0.187	0.170	0.157
250	0.395	0.355	0.319	0.286	0.257	0.230	0.207	0.187	0.170	0.157
260	0.395	0.355	0.319	0.286	0.257	0.230	0.207	0.186	0.170	0.157
270	0.395	0.355	0.319	0.286	0.256	0.230	0.206	0.186	0.169	0.156
280	0.395	0.355	0.319	0.286	0.256	0.230	0.206	0.186	0.169	0.156
290	0.395	0.355	0.319	0.285	0.256	0.229	0.206	0.186	0.169	0.156
300	0.395	0.354	0.318	0.285	0.256	0.229	0.206	0.185	0.168	0.155
310	0.394	0.354	0.318	0.285	0.255	0.229	0.205	0.185	0.168	0.155
320	0.393	0.353	0.317	0.284	0.254	0.228	0.205	0.184	0.168	0.155
330	0.392	0.352	0.316	0.283	0.254	0.227	0.204	0.184	0.167	0.154
340	0.391	0.351	0.315	0.282	0.253	0.227	0.203	0.183	0.166	0.153
350	0.390	0.350	0.314	0.281	0.252	0.226	0.203	0.182	0.166	0.153

= Above atmospheric boiling point

Table 21 — Thermal Conductivity (W/mK) of Aqueous Solutions of DOWTHERM 4000—SI Units

Temp. °C	Volume Percent Ethylene Glycol									
	0%	10%	20%	30%	40%	50%	60%	70%	80%	90%
-35							0.300	0.279	0.262	
-30						0.328	0.303	0.282	0.264	0.250
-25					0.361	0.332	0.306	0.284	0.266	0.252
-20					0.366	0.336	0.310	0.287	0.268	0.253
-15				0.405	0.371	0.340	0.313	0.289	0.270	0.255
-10				0.411	0.376	0.344	0.316	0.292	0.272	0.256
-5			0.458	0.417	0.381	0.348	0.319	0.294	0.273	0.257
0		0.512	0.466	0.423	0.386	0.352	0.322	0.297	0.275	0.259
5	0.572	0.520	0.472	0.429	0.391	0.356	0.325	0.299	0.277	0.260
10	0.582	0.528	0.479	0.435	0.395	0.360	0.328	0.301	0.278	0.261
15	0.591	0.535	0.486	0.440	0.400	0.363	0.331	0.303	0.280	0.262
20	0.599	0.543	0.492	0.445	0.404	0.367	0.334	0.305	0.281	0.263
25	0.608	0.550	0.498	0.450	0.408	0.370	0.336	0.307	0.283	0.264
30	0.615	0.556	0.503	0.455	0.412	0.373	0.338	0.309	0.284	0.265
35	0.623	0.563	0.509	0.459	0.415	0.376	0.341	0.311	0.285	0.266
40	0.630	0.569	0.514	0.463	0.419	0.378	0.343	0.312	0.286	0.267
45	0.636	0.574	0.518	0.467	0.422	0.381	0.345	0.314	0.288	0.268
50	0.642	0.579	0.523	0.471	0.425	0.383	0.347	0.315	0.289	0.268
55	0.648	0.584	0.527	0.474	0.427	0.385	0.348	0.316	0.289	0.269
60	0.653	0.588	0.530	0.477	0.430	0.387	0.350	0.317	0.290	0.270
65	0.657	0.592	0.534	0.480	0.432	0.389	0.351	0.318	0.291	0.270
70	0.662	0.596	0.537	0.483	0.434	0.391	0.352	0.319	0.292	0.271
75	0.666	0.599	0.539	0.485	0.436	0.392	0.354	0.320	0.292	0.271
80	0.669	0.602	0.542	0.487	0.438	0.394	0.355	0.321	0.293	0.271
85	0.672	0.605	0.544	0.489	0.439	0.395	0.355	0.322	0.293	0.271
90	0.675	0.607	0.546	0.490	0.440	0.396	0.356	0.322	0.294	0.272
95	0.677	0.609	0.548	0.491	0.441	0.396	0.357	0.322	0.294	0.272
100	0.679	0.610	0.549	0.493	0.442	0.397	0.357	0.323	0.294	0.272
105	0.681	0.612	0.550	0.493	0.443	0.398	0.358	0.323	0.294	0.272
110	0.682	0.613	0.551	0.494	0.443	0.398	0.358	0.323	0.294	0.272
115	0.683	0.614	0.552	0.495	0.444	0.398	0.358	0.323	0.294	0.272
120	0.684	0.614	0.552	0.495	0.444	0.398	0.358	0.323	0.294	0.272
125	0.684	0.615	0.552	0.495	0.444	0.398	0.358	0.323	0.294	0.271
130	0.684	0.615	0.552	0.495	0.444	0.398	0.358	0.323	0.293	0.271
135	0.684	0.615	0.552	0.495	0.444	0.398	0.357	0.322	0.293	0.271
140	0.684	0.614	0.552	0.494	0.443	0.397	0.357	0.322	0.293	0.270
145	0.684	0.614	0.551	0.494	0.443	0.397	0.356	0.321	0.292	0.270
150	0.683	0.613	0.551	0.493	0.442	0.396	0.356	0.321	0.291	0.269
155	0.682	0.612	0.550	0.492	0.441	0.395	0.355	0.320	0.291	0.268
160	0.681	0.611	0.549	0.491	0.440	0.395	0.354	0.319	0.290	0.268
165	0.679	0.610	0.547	0.490	0.439	0.394	0.353	0.318	0.289	0.267
170	0.678	0.608	0.546	0.489	0.438	0.392	0.352	0.317	0.288	0.266
175	0.676	0.607	0.545	0.488	0.437	0.391	0.351	0.316	0.287	0.265

= At or above atmospheric boiling point

Table 22 — Specific Heat (Btu/(lb·°F)) of Aqueous Solutions of DOWTHERM SR-1 Fluid—English Units

Temp. °F	Volume Percent Ethylene Glycol									
	0%	10%	20%	30%	40%	50%	60%	70%	80%	90%
-30							0.680	0.625	0.567	
-20						0.739	0.686	0.631	0.574	0.515
-10						0.744	0.692	0.638	0.581	0.523
0					0.799	0.749	0.698	0.644	0.588	0.530
10				0.849	0.803	0.754	0.703	0.651	0.595	0.538
20			0.897	0.853	0.808	0.759	0.709	0.657	0.603	0.546
30		0.940	0.900	0.857	0.812	0.765	0.715	0.664	0.610	0.553
40	1.004	0.943	0.903	0.861	0.816	0.770	0.721	0.670	0.617	0.561
50	1.001	0.945	0.906	0.864	0.821	0.775	0.727	0.676	0.624	0.569
60	1.000	0.947	0.909	0.868	0.825	0.780	0.732	0.683	0.631	0.576
70	0.999	0.950	0.912	0.872	0.830	0.785	0.738	0.689	0.638	0.584
80	0.998	0.952	0.915	0.876	0.834	0.790	0.744	0.696	0.645	0.592
90	0.998	0.954	0.918	0.880	0.839	0.795	0.750	0.702	0.652	0.600
100	0.998	0.957	0.922	0.883	0.843	0.800	0.756	0.709	0.659	0.607
110	0.998	0.959	0.925	0.887	0.848	0.806	0.761	0.715	0.666	0.615
120	0.998	0.961	0.928	0.891	0.852	0.811	0.767	0.721	0.673	0.623
130	0.999	0.964	0.931	0.895	0.857	0.816	0.773	0.728	0.680	0.630
140	0.999	0.966	0.934	0.898	0.861	0.821	0.779	0.734	0.687	0.638
150	1.000	0.968	0.937	0.902	0.865	0.826	0.785	0.741	0.694	0.646
160	1.001	0.971	0.940	0.906	0.870	0.831	0.790	0.747	0.702	0.654
170	1.002	0.973	0.943	0.910	0.874	0.836	0.796	0.754	0.709	0.661
180	1.003	0.975	0.946	0.913	0.879	0.842	0.802	0.760	0.716	0.669
190	1.004	0.978	0.949	0.917	0.883	0.847	0.808	0.766	0.723	0.677
200	1.005	0.980	0.952	0.921	0.888	0.852	0.813	0.773	0.730	0.684
210	1.007	0.982	0.955	0.925	0.892	0.857	0.819	0.779	0.737	0.692
220	1.008	0.985	0.958	0.929	0.897	0.862	0.825	0.786	0.744	0.700
230	1.010	0.987	0.961	0.932	0.901	0.867	0.831	0.792	0.751	0.708
240	1.012	0.989	0.964	0.936	0.905	0.872	0.837	0.799	0.758	0.715
250	1.014	0.992	0.967	0.940	0.910	0.877	0.842	0.805	0.765	0.723


 = Above atmospheric boiling point

Table 23 — Specific Heat (kJ/kg K) of Aqueous Solutions of DOWTHERM SR-1 Fluid—SI Units

Temp. °C	Volume Percent Ethylene Glycol									
	0%	10%	20%	30%	40%	50%	60%	70%	80%	90%
-35							2.845	2.613	2.371	
-30						3.089	2.867	2.637	2.398	2.149
-25					3.319	3.108	2.889	2.662	2.424	2.178
-20					3.335	3.128	2.911	2.686	2.451	2.207
-15				3.548	3.352	3.147	2.933	2.710	2.478	2.236
-10				3.562	3.369	3.166	2.954	2.734	2.504	2.265
-5			3.759	3.576	3.386	3.185	2.976	2.759	2.531	2.294
0		3.939	3.771	3.590	3.403	3.205	2.998	2.783	2.558	2.323
5	4.229	3.947	3.782	3.604	3.419	3.224	3.020	2.807	2.584	2.352
10	4.195	3.956	3.794	3.619	3.436	3.243	3.042	2.831	2.611	2.381
15	4.168	3.965	3.805	3.633	3.453	3.263	3.063	2.855	2.638	2.410
20	4.147	3.974	3.816	3.647	3.46:	3.282	3.085	2.880	2.664	2.439
25	4.132	3.982	3.828	3.661	3.486	3.301	3.107	2.904	2.691	2.468
30	4.121	3.991	3.839	3.675	3.503	3.321	3.129	2.928	2.717	2.497
35	4.115	4.000	3.851	3.690	3.520	3.340	3.151	2.952	2.744	2.526
40	4.114	4.009	3.862	3.704	3.537	3.359	3.172	2.977	2.771	2.555
45	4.115	4.017	3.874	3.718	3.554	3.379	3.194	3.001	2.797	2.584
50	4.120	4.026	3.885	3.732	3.56:	3.398	3.216	3.025	2.824	2.613
55	4.128	4.035	3.897	3.746	3.587	3.417	3.238	3.049	2.851	2.642
60	4.138	4.044	3.908	3.761	3.604	3.437	3.260	3.074	2.877	2.671
65	4.150	4.052	3.920	3.775	3.621	3.456	3.281	3.098	2.904	2.700
70	4.164	4.061	3.931	3.789	3.637	3.475	3.303	3.122	2.931	2.729
75	4.179	4.070	3.943	3.803	3.654	3.495	3.325	3.146	2.957	2.758
80	4.196	4.079	3.954	3.817	3.671	3.514	3.347	3.171	2.984	2.787
85	4.213	4.087	3.966	3.831	3.688	3.533	3.369	3.195	3.011	2.816
90	4.231	4.096	3.977	3.846	3.705	3.553	3.390	3.219	3.037	2.845
95	4.249	4.105	3.989	3.860	3.721	3.572	3.412	3.243	3.064	2.875
100	4.267	4.113	4.000	3.874	3.738	3.591	3.434	3.268	3.091	2.904
105	4.285	4.122	4.012	3.888	3.755	3.610	3.456	3.292	3.117	2.933
110	4.303	4.131	4.023	3.902	3.772	3.630	3.478	3.316	3.144	2.962
115	4.321	4.140	4.035	3.917	3.788	3.649	3.499	3.340	3.171	2.991
120	4.338	4.148	4.046	3.931	3.805	3.668	3.521	3.365	3.197	3.020

■ = At or above atmospheric boiling point

Table 24 — Specific Heat (Btu/(lb·°F)) of Aqueous Solutions of DOWTHERM 4000 Fluid—English Units

Temp. °F	Volume Percent Ethylene Glycol									
	0%	10%	20%	30%	40%	50%	60%	70%	80%	90%
-30							0.668	0.610	0.550	
-20						0.730	0.674	0.617	0.557	0.495
-10						0.735	0.680	0.624	0.564	0.503
0					0.792	0.740	0.686	0.630	0.572	0.511
10				0.845	0.796	0.745	0.692	0.637	0.579	0.519
20			0.894	0.848	0.801	0.751	0.698	0.643	0.586	0.527
30		0.939	0.897	0.852	0.805	0.756	0.704	0.650	0.593	0.534
40	1.004	0.941	0.900	0.856	0.810	0.761	0.710	0.657	0.601	0.542
50	1.001	0.944	0.903	0.860	0.814	0.766	0.716	0.663	0.608	0.550
60	1.000	0.946	0.907	0.864	0.819	0.772	0.722	0.670	0.615	0.558
70	0.999	0.948	0.910	0.868	0.824	0.777	0.728	0.676	0.622	0.566
80	0.998	0.951	0.913	0.871	0.828	0.782	0.734	0.683	0.630	0.574
90	0.998	0.953	0.916	0.875	0.833	0.787	0.740	0.690	0.637	0.582
100	0.998	0.956	0.919	0.879	0.837	0.793	0.746	0.696	0.644	0.590
110	0.998	0.958	0.922	0.883	0.842	0.798	0.751	0.703	0.652	0.598
120	0.998	0.960	0.925	0.887	0.846	0.803	0.757	0.709	0.659	0.606
130	0.999	0.963	0.928	0.891	0.851	0.808	0.763	0.716	0.666	0.614
140	0.999	0.965	0.931	0.895	0.855	0.814	0.769	0.723	0.673	0.621
150	1.000	0.967	0.934	0.898	0.860	0.819	0.775	0.729	0.681	0.629
160	1.001	0.970	0.938	0.902	0.865	0.824	0.781	0.736	0.688	0.637
170	1.002	0.972	0.941	0.906	0.869	0.829	0.787	0.742	0.695	0.645
180	1.003	0.974	0.944	0.910	0.874	0.835	0.793	0.749	0.702	0.653
190	1.004	0.977	0.947	0.914	0.878	0.840	0.799	0.756	0.710	0.661
200	1.005	0.979	0.950	0.918	0.883	0.845	0.805	0.762	0.717	0.669
210	1.007	0.981	0.953	0.921	0.887	0.850	0.811	0.769	0.724	0.677
220	1.008	0.984	0.956	0.925	0.892	0.856	0.817	0.775	0.731	0.685
230	1.010	0.986	0.959	0.929	0.896	0.861	0.823	0.782	0.739	0.693
240	1.012	0.988	0.962	0.933	0.901	0.866	0.829	0.789	0.746	0.701
250	1.014	0.991	0.965	0.937	0.905	0.871	0.834	0.795	0.753	0.709
260	1.017	0.993	0.969	0.941	0.910	0.877	0.840	0.802	0.760	0.716
270	1.019	0.995	0.972	0.944	0.915	0.882	0.846	0.808	0.768	0.724
280	1.022	0.998	0.975	0.948	0.919	0.887	0.852	0.815	0.775	0.732
290	1.025	1.000	0.978	0.952	0.924	0.892	0.858	0.822	0.782	0.740
300	1.029	1.002	0.981	0.956	0.928	0.898	0.864	0.828	0.789	0.748
310	1.032	1.005	0.984	0.960	0.933	0.903	0.870	0.835	0.797	0.756
320	1.036	1.007	0.987	0.964	0.937	0.908	0.876	0.841	0.804	0.764
330	1.040	1.010	0.990	0.967	0.942	0.913	0.882	0.848	0.811	0.772
340	1.045	1.012	0.993	0.971	0.946	0.919	0.888	0.855	0.819	0.780
350	1.050	1.014	0.996	0.975	0.951	0.924	0.894	0.861	0.826	0.788

= Above atmospheric boiling point

Table 25 — Specific Heat (kJ/kg K) of Aqueous Solutions of DOWTHERM 4000 Fluid—SI Units

Temp. °C	Volume Percent Ethylene Glycol									
	0%	10%	20%	30%	40%	50%	60%	70%	80%	90%
-35							2.795	2.552	2.299	
-30						3.050	2.818	2.577	2.326	2.065
-25					3.289	3.069	2.840	2.602	2.353	2.095
-20					3.306	3.089	2.862	2.627	2.381	2.124
-15				3.527	3.323	3.109	2.885	2.652	2.408	2.154
-10				3.542	3.341	3.129	2.907	2.677	2.435	2.184
-5			3.747	3.556	3.358	3.149	2.929	2.702	2.463	2.214
0		3.933	3.758	3.571	3.375	3.168	2.952	2.726	2.490	2.244
5	4.229	3.942	3.770	3.585	3.392	3.188	2.974	2.751	2.518	2.274
10	4.195	3.951	3.782	3.600	3.409	3.208	2.997	2.776	2.545	2.303
15	4.168	3.959	3.793	3.614	3.426	3.228	3.019	2.801	2.572	2.333
20	4.147	3.968	3.805	3.629	3.443	3.247	3.041	2.826	2.600	2.363
25	4.132	3.977	3.817	3.643	3.461	3.267	3.064	2.851	2.627	2.393
30	4.121	3.986	3.828	3.658	3.478	3.287	3.086	2.876	2.654	2.423
35	4.115	3.995	3.840	3.672	3.495	3.307	3.108	2.900	2.682	2.452
40	4.114	4.004	3.852	3.686	3.512	3.326	3.131	2.925	2.709	2.482
45	4.115	4.012	3.864	3.701	3.529	3.346	3.153	2.950	2.736	2.512
50	4.120	4.021	3.875	3.715	3.546	3.366	3.175	2.975	2.764	2.542
55	4.128	4.030	3.887	3.730	3.563	3.386	3.198	3.000	2.791	2.572
60	4.138	4.039	3.899	3.744	3.581	3.406	3.220	3.025	2.818	2.602
65	4.150	4.048	3.910	3.759	3.598	3.425	3.242	3.050	2.846	2.631
70	4.164	4.057	3.922	3.773	3.615	3.445	3.265	3.074	2.873	2.661
75	4.179	4.066	3.934	3.788	3.632	3.465	3.287	3.099	2.900	2.691
80	4.196	4.074	3.945	3.802	3.649	3.485	3.309	3.124	2.928	2.721
85	4.213	4.083	3.957	3.817	3.666	3.504	3.332	3.149	2.955	2.751
90	4.231	4.092	3.969	3.831	3.683	3.524	3.354	3.174	2.983	2.780
95	4.249	4.101	3.980	3.846	3.701	3.544	3.376	3.199	3.010	2.810
100	4.267	4.110	3.992	3.860	3.718	3.564	3.399	3.224	3.037	2.840
105	4.285	4.119	4.004	3.875	3.735	3.583	3.421	3.248	3.065	2.870
110	4.303	4.127	4.015	3.889	3.752	3.603	3.443	3.273	3.092	2.900
115	4.321	4.136	4.027	3.903	3.769	3.623	3.466	3.298	3.119	2.930
120	4.338	4.145	4.039	3.918	3.786	3.643	3.488	3.323	3.147	2.959
125	4.355	4.154	4.050	3.932	3.803	3.662	3.510	3.348	3.174	2.989
130	4.371	4.163	4.062	3.947	3.821	3.682	3.533	3.373	3.201	3.019
135	4.387	4.172	4.074	3.961	3.838	3.702	3.555	3.398	3.229	3.049
140	4.402	4.181	4.085	3.976	3.855	3.722	3.577	3.422	3.256	3.079
145	4.416	4.189	4.097	3.990	3.872	3.742	3.600	3.447	3.283	3.108
150	4.430	4.198	4.109	4.005	3.889	3.761	3.622	3.472	3.311	3.138
155	4.443	4.207	4.121	4.019	3.906	3.781	3.644	3.497	3.338	3.168
160	4.456	4.216	4.132	4.034	3.923	3.801	3.667	3.522	3.365	3.198
165	4.468	4.225	4.144	4.048	3.941	3.821	3.689	3.547	3.393	3.228
170	4.481	4.234	4.156	4.063	3.958	3.840	3.711	3.572	3.420	3.258
175	4.493	4.242	4.167	4.077	3.975	3.860	3.734	3.596	3.448	3.287

■ = At or above atmospheric boiling point

Table 26 — Vapor Pressure of Aqueous Solutions of DOWTHERM SR-1 and DOWTHERM 4000 Fluids, psia—English Units

Temp. °F	Volume Percent Ethylene Glycol									
	0%	10%	20%	30%	40%	50%	60%	70%	80%	90%
100	1.0	0.9	0.9	0.8						
110	1.3	1.2	1.2	1.1	1.0					
120	1.7	1.6	1.6	1.5	1.4	1.3	1.1			
130	2.2	2.2	2.1	2.0	1.8	1.7	1.5	1.3		
140	2.9	2.8	2.7	2.5	2.4	2.2	2.0	1.7	1.3	
150	3.7	3.6	3.5	3.3	3.1	2.8	2.6	2.2	1.7	
160	4.7	4.6	4.4	4.2	3.9	3.6	3.3	2.8	2.2	1.3
170	6.0	5.8	5.6	5.3	5.0	4.6	4.2	3.6	2.8	1.7
180	7.5	7.3	7.0	6.7	6.3	5.8	5.3	4.6	3.6	2.1
190	9.3	9.1	8.7	8.3	7.8	7.2	6.6	5.7	4.5	2.7
200	11.5	11.2	10.8	10.3	9.7	9.0	8.2	7.1	5.6	3.4
210	14.1	13.7	13.2	12.6	11.8	11.0	10.0	8.7	6.9	4.3
220	17.2	16.7	16.1	15.3	14.4	13.4	12.3	10.7	8.4	5.3
230	20.8	20.1	19.4	18.5	17.5	16.2	14.9	12.9	10.3	6.5
240	25.0	24.2	23.3	22.3	21.0	19.5	17.9	15.6	12.4	7.8
250	29.8	28.9	27.9	26.6	25.1	23.3	21.4	18.6	14.8	9.4
260	35.4	34.3	33.1	31.6	29.8	27.7	25.4	22.2	17.7	11.3
270	41.8	40.6	39.1	37.3	35.2	32.8	30.1	26.2	20.9	13.4
280	49.2	47.7	46.0	43.9	41.4	38.5	35.3	30.9	24.6	15.8
290	57.5	55.8	53.8	51.3	48.4	45.0	41.3	36.1	28.8	18.6
300	67.0	65.0	62.6	59.7	56.3	52.4	48.1	42.0	33.5	21.6
310	77.6	75.3	72.6	69.2	65.2	60.7	55.7	48.7	38.8	25.1
320	89.6	86.9	83.7	79.8	75.2	69.9	64.3	56.1	44.7	29.0
330	103.0	100.0	96.2	91.7	86.4	80.3	73.8	64.4	51.3	33.3
340	117.9	114.5	110.2	105.0	98.9	91.8	84.4	73.7	58.6	38.0
350	134.5	130.6	125.7	119.7	112.7	104.6	96.2	83.9	66.7	43.2

**Table 27 — Vapor Pressure of Aqueous Solutions
of DOWTHERM SR-1 and DOWTHERM 4000 Fluids, kPa–SI Units**

Temp. °C	Volume Percent Ethylene Glycol									
	0%	10%	20%	30%	40%	50%	60%	70%	80%	90%
50	12.3	12.0	11.4	10.8	10.1	9.2	8.2	7.0		
55	15.8	15.3	14.6	13.8	12.9	11.9	10.6	9.0	6.9	
60	19.9	19.3	18.5	17.5	16.4	15.1	13.6	11.6	8.9	
65	25.0	24.3	23.3	22.1	20.7	19.1	17.2	14.7	11.3	6.5
70	31.2	30.2	29.0	27.6	25.8	23.9	21.6	18.5	14.3	8.4
75	38.6	37.4	35.9	34.2	32.1	29.7	26.9	23.1	18.0	10.6
80	47.4	45.9	44.2	42.0	39.5	36.6	33.2	28.6	22.3	13.4
85	57.8	56.0	53.9	51.3	48.3	44.8	40.7	35.2	27.6	16.7
90	70.1	68.0	65.4	62.3	58.7	54.4	49.6	42.9	33.7	20.6
95	84.5	81.9	78.9	75.2	70.8	65.8	60.0	52.0	41.0	25.3
100	101.3	98.2	94.6	90.2	85.0	79.0	72.1	62.6	49.5	30.8
105	120.8	117.1	112.8	107.6	101.4	94.3	86.2	75.0	59.3	37.1
110	143.2	138.8	133.8	127.7	120.4	111.9	102.4	89.2	70.7	44.5
115	169.0	163.8	157.9	150.7	142.1	132.2	121.1	105.5	83.8	53.0
120	198.4	192.4	185.5	177.0	166.9	155.3	142.4	124.1	98.7	62.8
125	232.0	224.9	216.8	206.9	195.2	181.6	166.6	145.3	115.7	73.8
130	270.0	261.8	252.4	240.8	227.2	211.4	194.0	169.3	134.9	86.4
135	312.9	303.5	292.5	279.1	263.3	245.0	224.9	196.3	156.5	100.5
140	361.2	350.3	337.6	322.1	303.8	282.7	259.6	226.7	180.7	116.4
145	415.3	402.8	388.2	370.3	349.2	324.9	298.5	260.6	207.8	134.1
150	475.7	461.6	444.7	424.1	399.9	372.0	341.8	298.5	238.0	153.8
155	543.0	526.9	507.6	484.0	456.3	424.3	389.9	340.5	271.4	175.6
160	617.7	599.5	577.3	550.4	518.7	482.3	443.2	387.0	308.4	199.7
165	700.3	679.8	654.5	623.8	587.7	546.2	502.1	438.2	349.1	226.2
170	791.5	768.5	739.7	704.7	663.7	616.7	566.8	494.6	393.9	255.3
175	891.9	866.1	833.3	793.7	747.3	694.0	637.9	556.5	442.8	287.0

Figure 1 — Pressure Drop at 30 Percent (volume) Ethylene Glycol—English Units

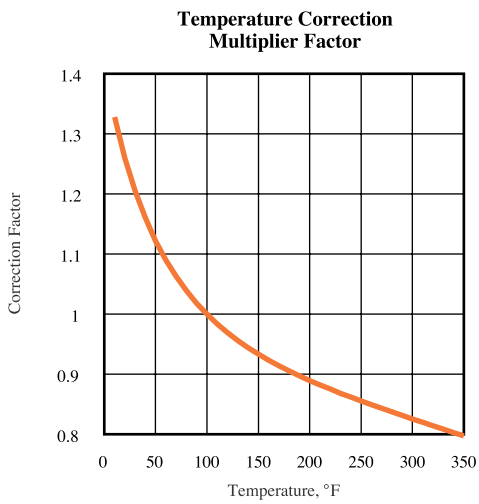
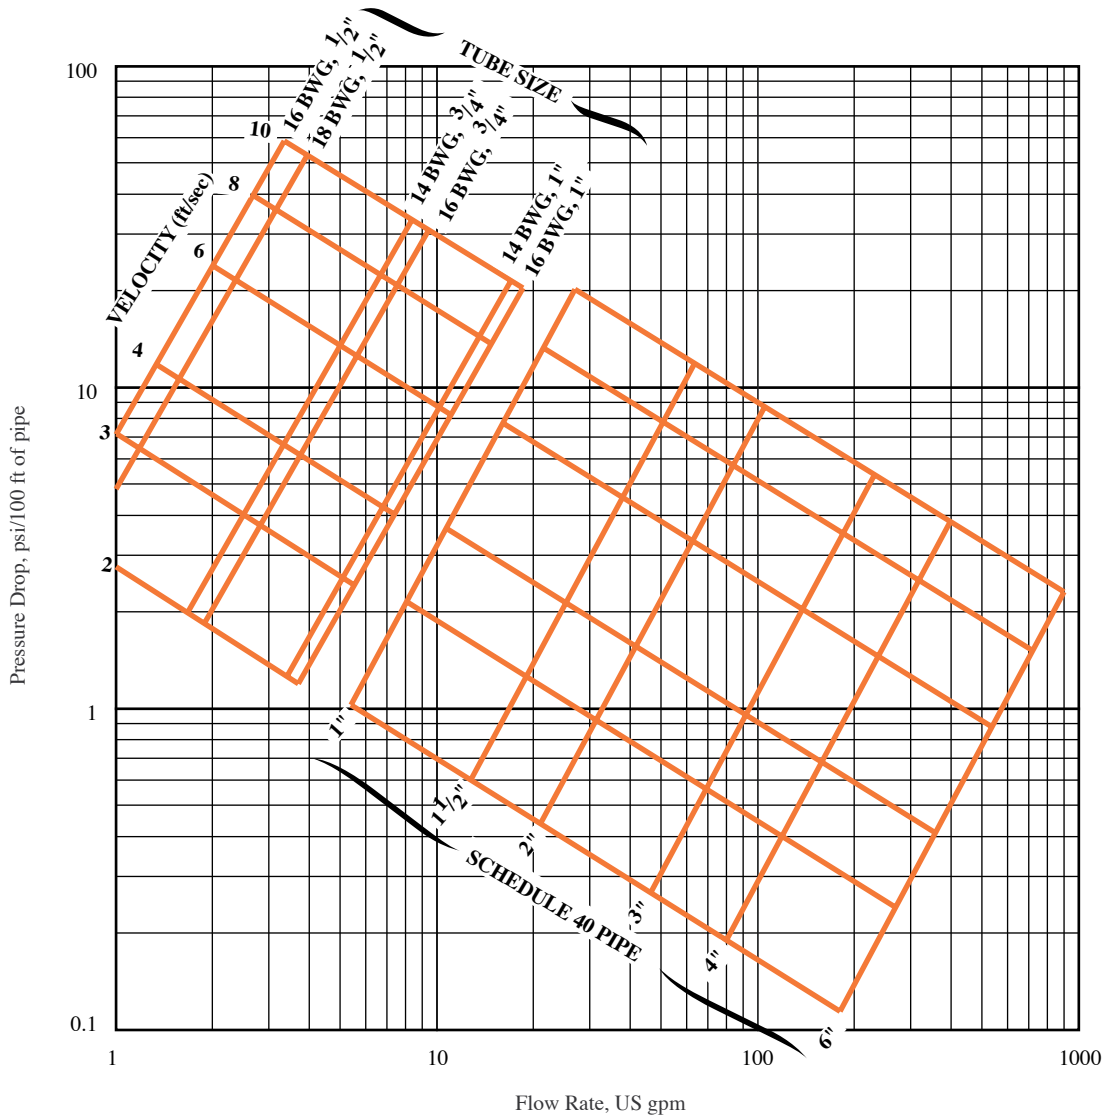


Figure 2 — Pressure Drop at 30 Percent (volume) Ethylene Glycol—SI Units

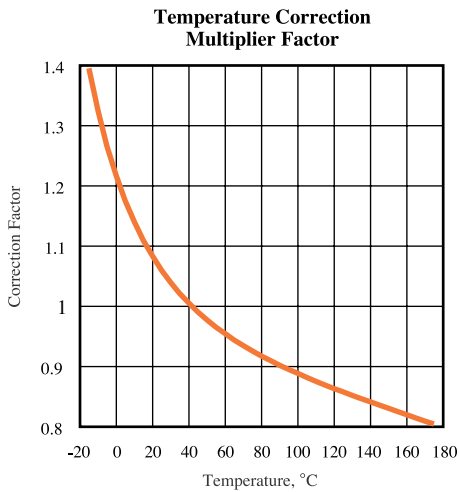
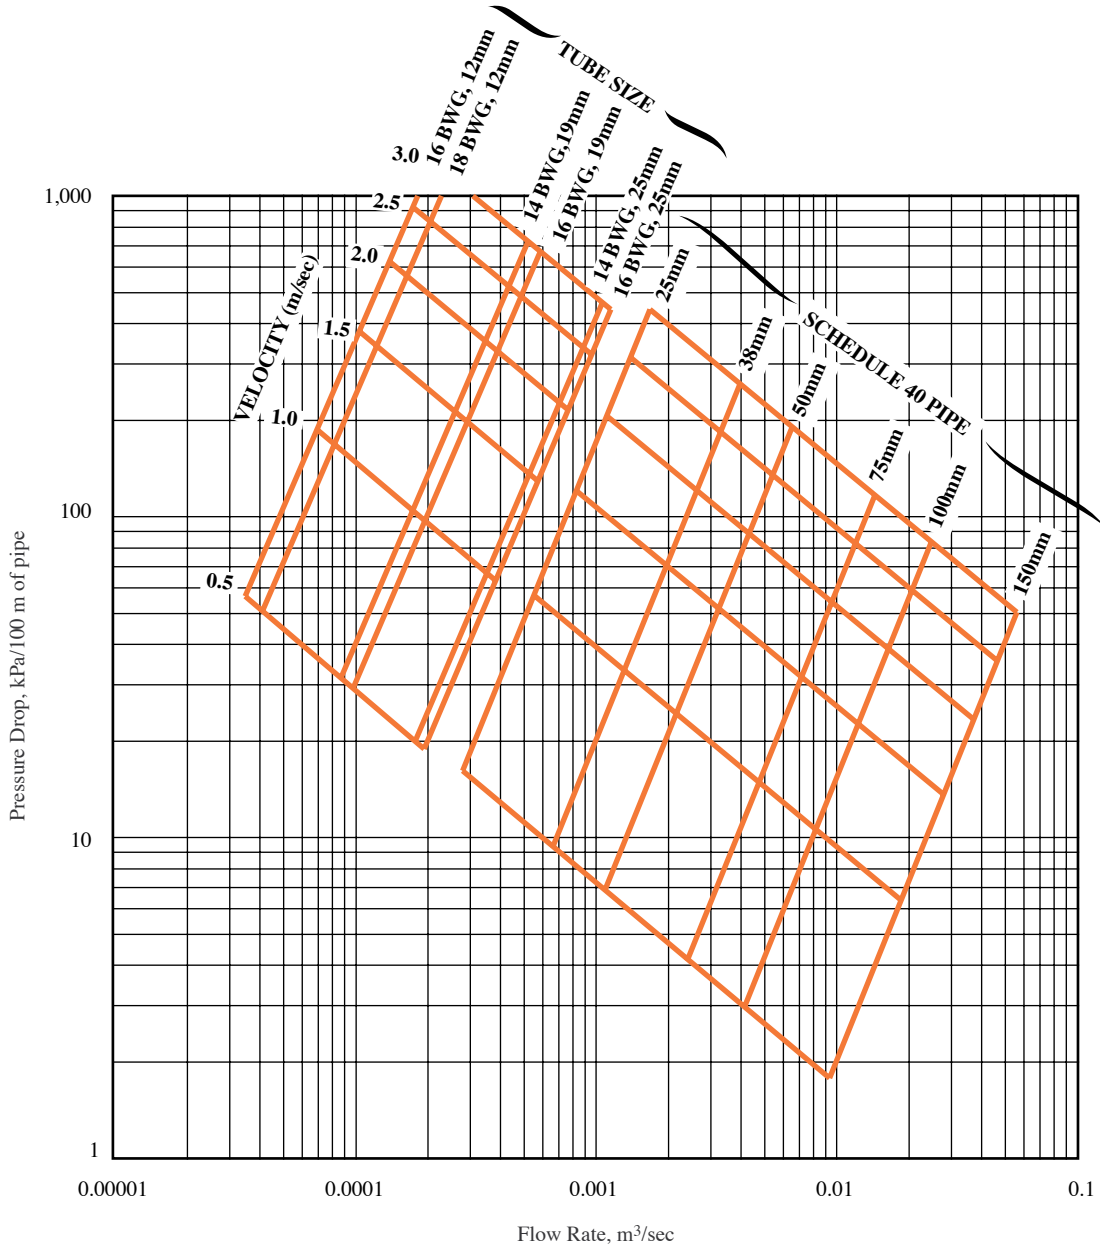


Figure 3 — Pressure Drop at 40 Percent (volume) Ethylene Glycol—English Units

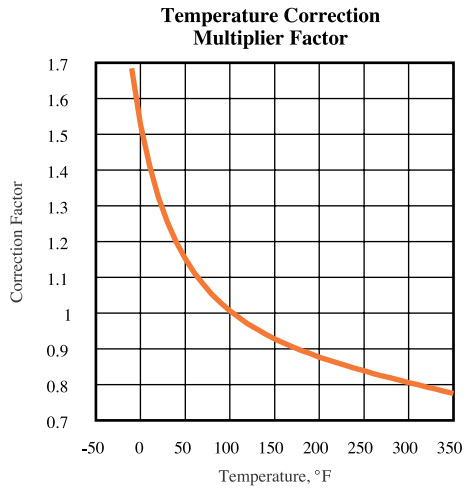
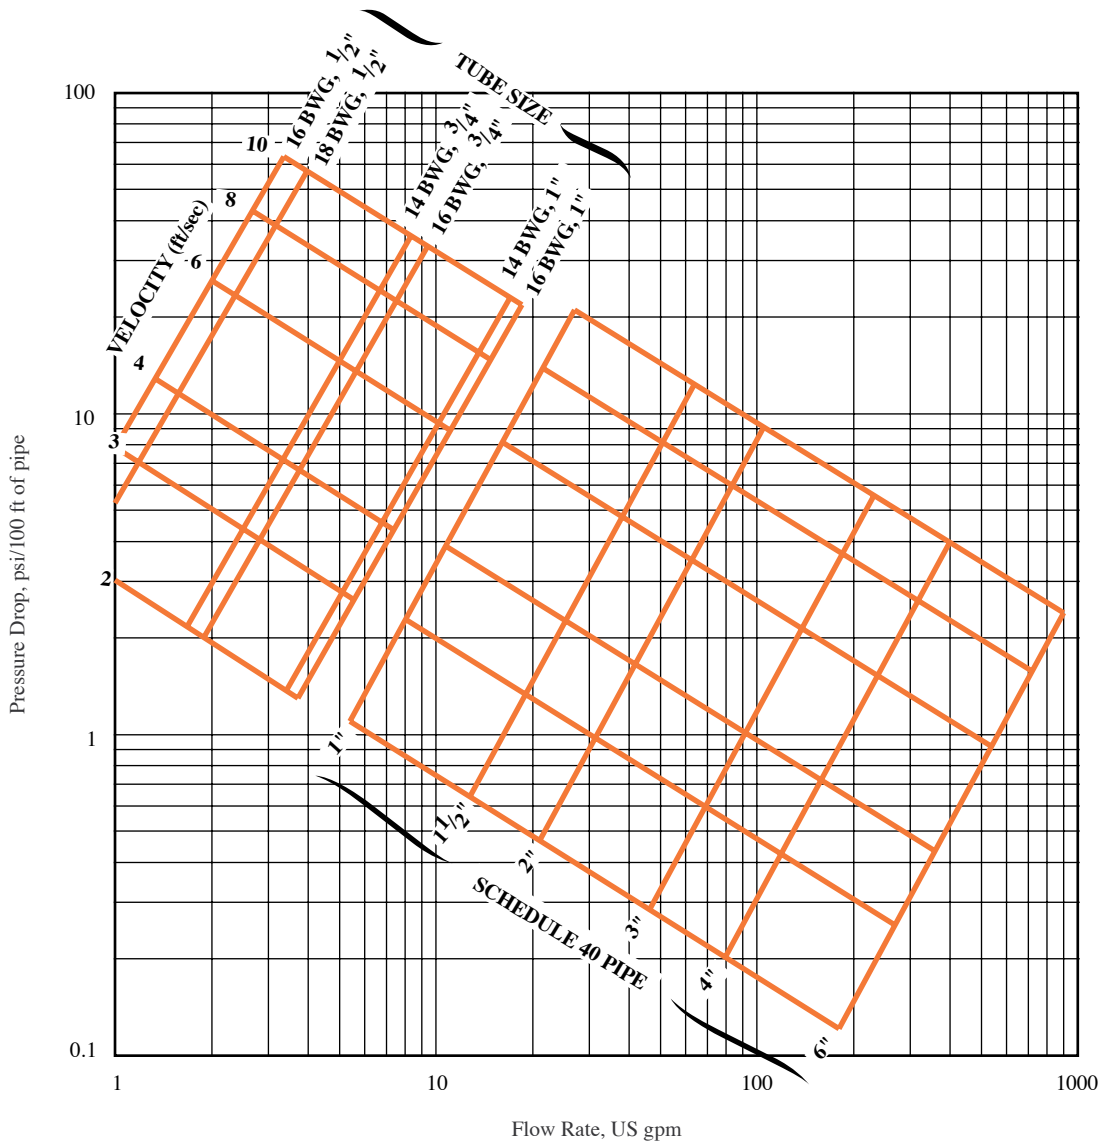


Figure 4 — Pressure Drop at 40 Percent (volume) Ethylene Glycol—SI Units

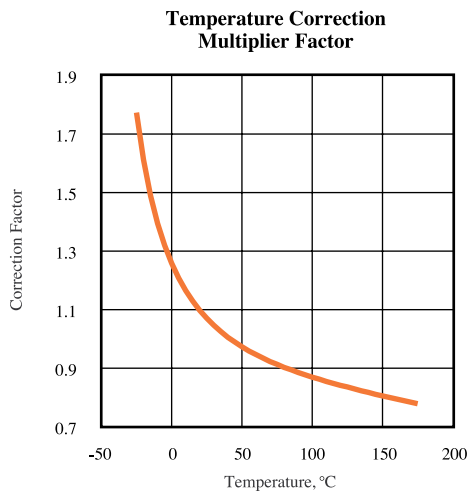
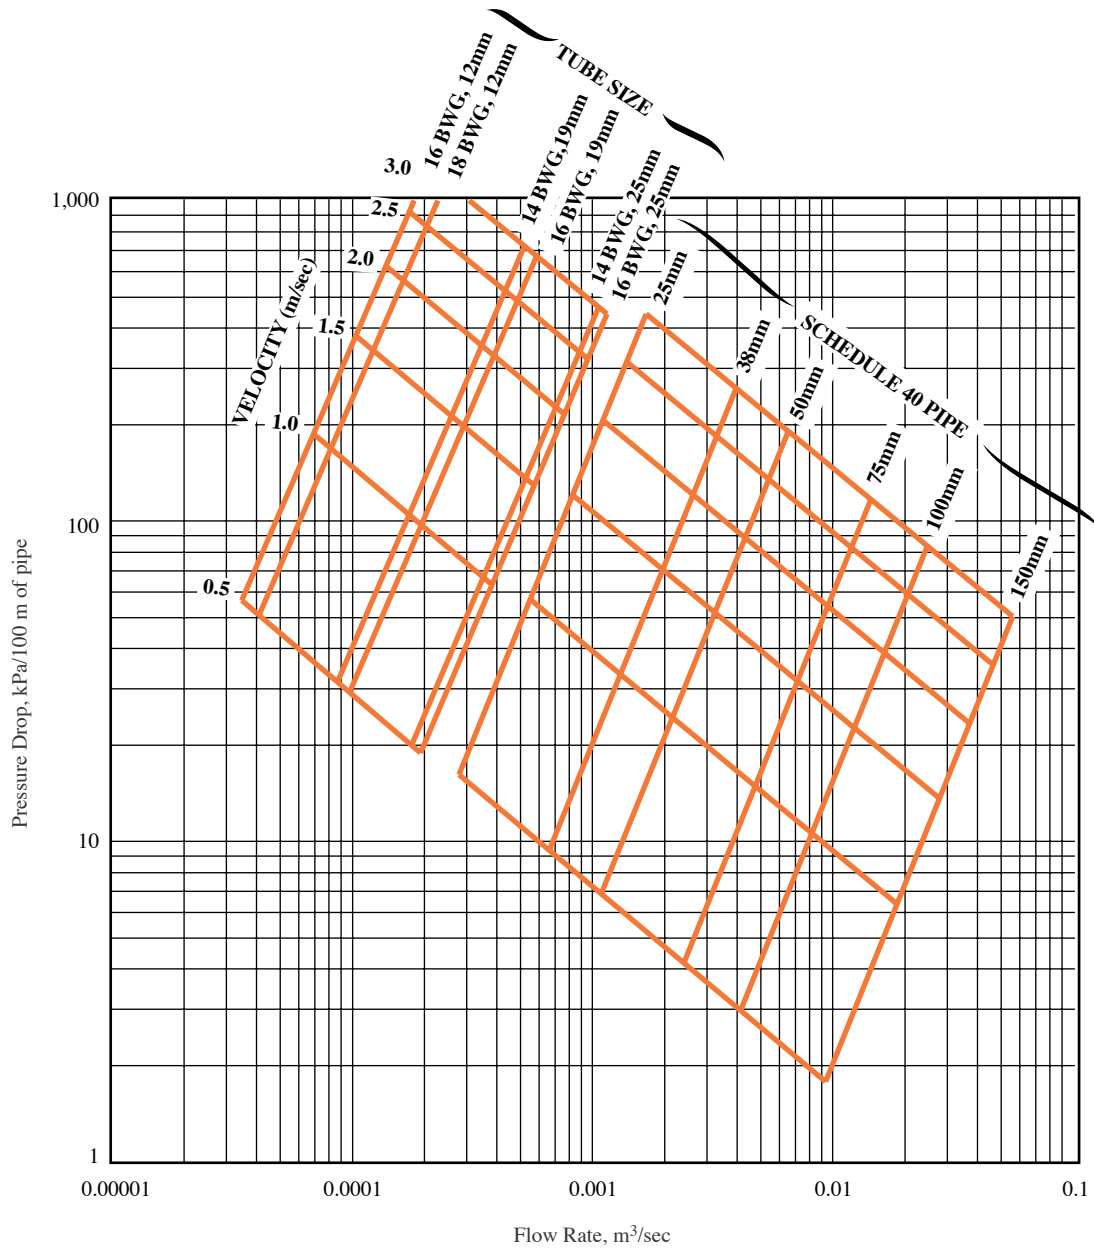


Figure 5 — Pressure Drop at 50 Percent (volume) Ethylene Glycol—English Units




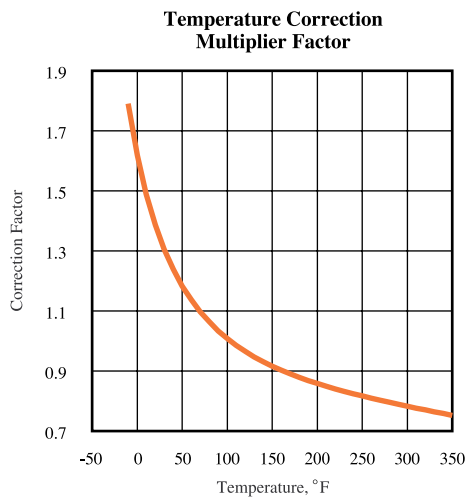


Figure 6 — Pressure Drop at 50 Percent (volume) Ethylene Glycol—SI Units

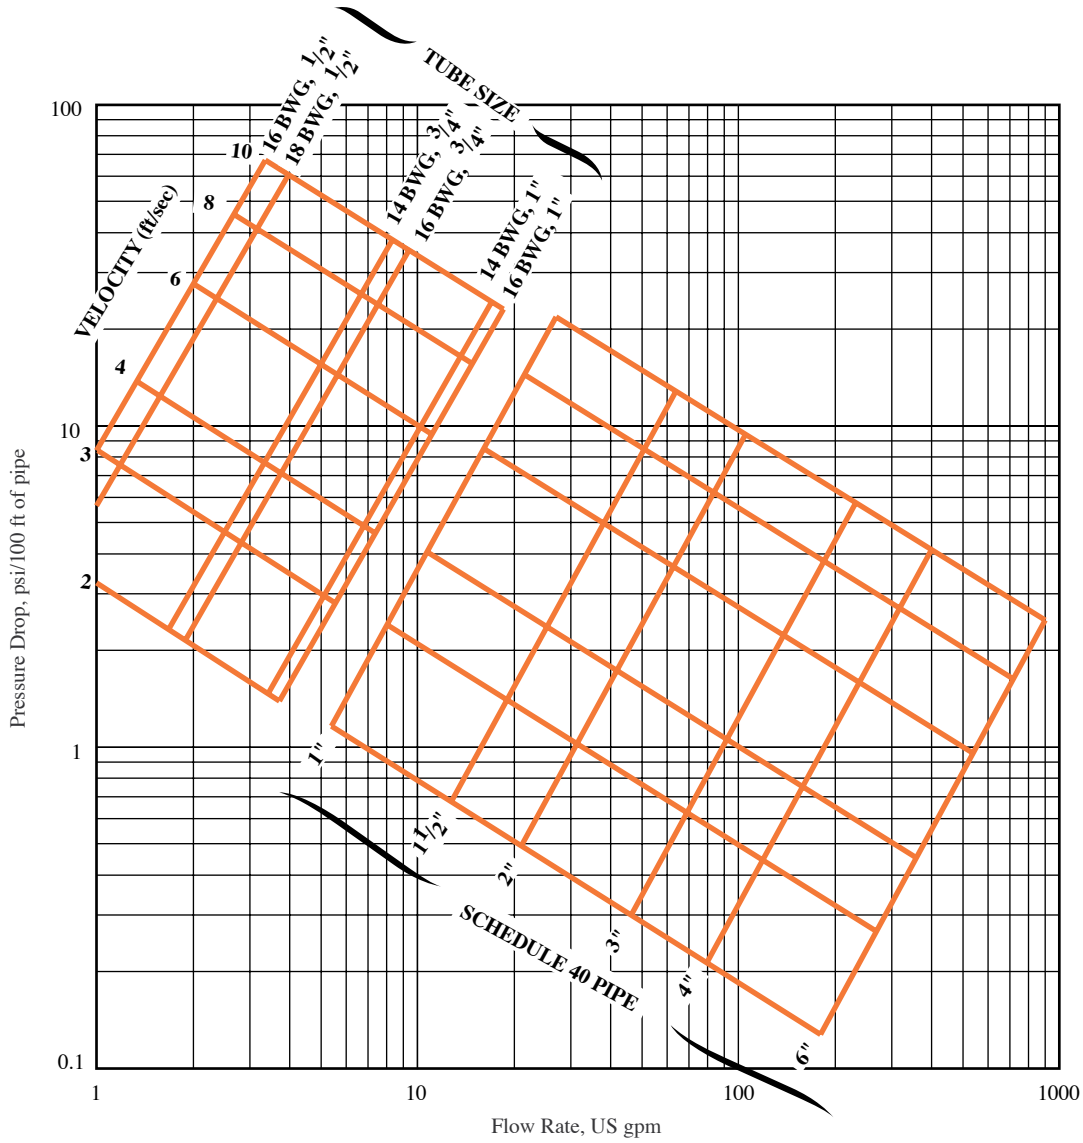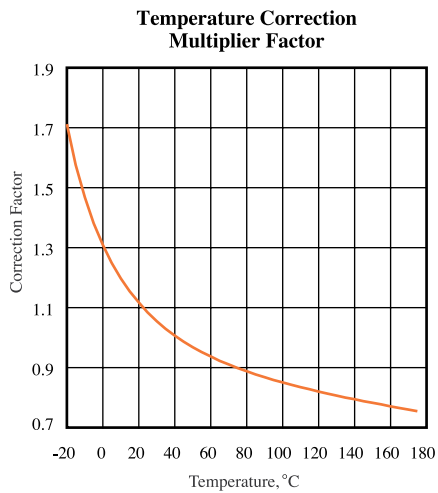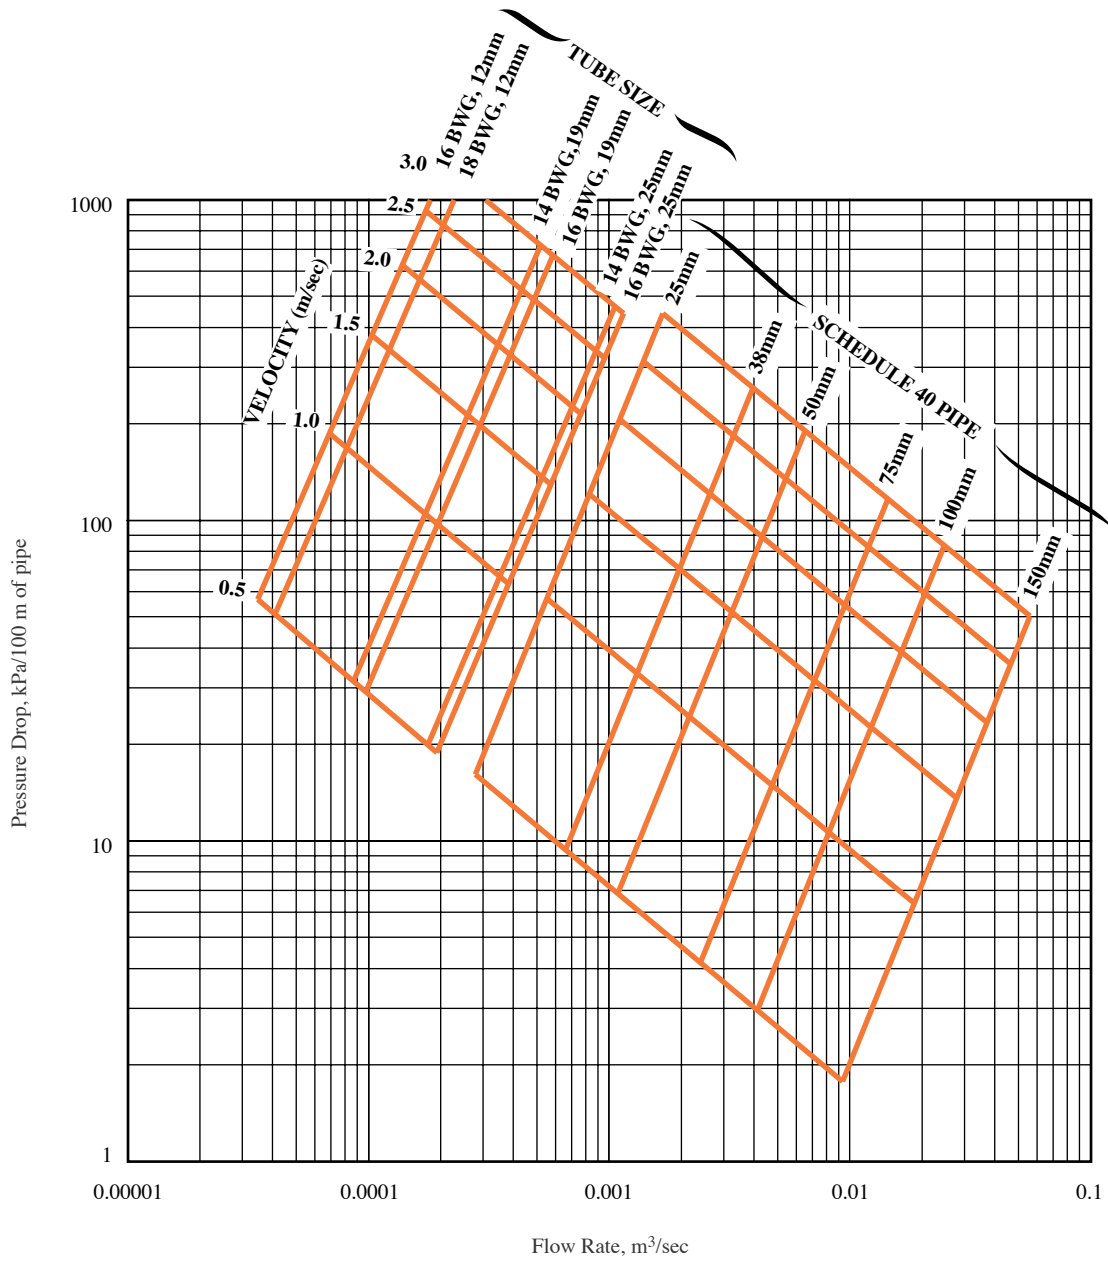

SAFETY, HANDLING, STORAGE, AND DISPOSAL OF DOWTHERM ETHYLENE GLYCOL-BASED FLUIDS

Toxicology

For complete product toxicological information for DOWTHERM fluids, request Material Safety Data (MSD) sheets from Dow. The MSD sheets provide the most up-to-date health and safety considerations related to the use of these products and should be consulted prior to use of the products.

Storage

Storage of DOWTHERM glycol-based heat transfer fluids presents no unusual problems. The materials do not readily solidify, are moderately toxic, have high flash points, and can be handled without posing a hazard to health. As a precaution, however, sparks or flames should be avoided during transfer or processing operations because undiluted glycols can be ignited. Tank truck shipments can be emptied into storage tanks or clean drums.

Tank storage

Ordinary steel tanks are normally satisfactory for storage of DOWTHERM fluids. However, during extended storage, slight discoloration may occur from iron contamination. Rusting may occur in the vapor space because there is no inhibitor where condensation occurs and

oxygen is present. This problem can be minimized by closing any vent to the tank to limit oxygen intake. If this is not possible, see page 11 for a discussion of coatings suitable for protection of the vapor space in tanks.

Insulation and heat are required for storage of DOWTHERM fluids at low temperatures. This will prevent freezing or pumping problems due to high viscosity. Maintaining temperatures above 10°F (-12°C) is usually sufficient to avoid such problems.

Drum storage

DOWTHERM fluids may be stored in the drums in which shipment is made. Because glycols are hygroscopic, it is important that the drum cap be replaced tightly after each withdrawal to keep the material in

the drum from absorbing water. Drums should be stored inside a heated building when temperatures below 10°F (-12°C) are anticipated. This will assure that the glycol is in a liquid form when needed.

Environmental considerations

The biochemical oxygen demand (BOD) for ethylene glycol approaches the theoretical oxygen demand (ThOD) value in the standard 20-day test period. This indicates that these materials are biodegradable and should not concentrate in common water systems. The possibility of spills into lakes or rivers, however, should be avoided, since rapid oxygen depletion may have harmful effects on aquatic organisms. Extensive testing of the effects of ethylene glycol on aquatic organisms has shown the material to be practically non-toxic (LC 50 > 100 mg/L) with LC 50's ≥ 10,000 mg/L for fathead minnow, rainbow trout, bluegill, *Daphnia magna*, and *Ceriodaphnia dubia/affinis*.

Table 17 — Biochemical Oxygen Demand for Ethylene Glycol

BOD	Parts Oxygen/Parts Ethylene Glycol
5 day	0.78
10 day	1.06
20 day	1.15
ThOD	1.29

Spill, leak, and disposal procedures

Using appropriate safety equipment, small spills may be soaked up using common absorbent material. For large spills, the fluid should be pumped into suitable containers located in diked areas. Residual material should be cleaned up with water. Concentrate can be handled according to local, state, and federal regulations.

Salvage

Some distributors of DOWTHERM fluids are equipped to reclaim and/or dispose of spent or contaminated fluids. Occasionally, where regulations permit, diluted spent fluids that are not otherwise contaminated can be disposed of in local sewage treatment facilities, provided those facilities are advised and prepared for such disposal in advance. Aerobic bacteria easily oxidize the fluids to carbon dioxide and water within the usual 20-day test period. The Dow Chemical Company does not provide a disposal or reprocessing service for spent or contaminated glycol-based fluids.

RECEIVE THESE FREE THERMAL FLUID EVALUATION TOOLS AT OUR WEBSITE

WWW.DOWTHERM.COM

Application-specific product literature: Select literature for your application from the Dow library of brochures about DOWTHERM and DOWFROST fluids. Applications brochures and data sheets are available for applications including HVAC and food processing. Also available are brochures detailing advantages of specific DOWTHERM and DOWFROST fluids.

HVAC Focus newsletter: Receive this informative newsletter to stay abreast of the latest information on HVAC system design and operation.

Engineering and Operating Guide

*for DOWTHERM SR-1 and DOWTHERM 4000
Inhibited Ethylene Glycol-based Heat Transfer Fluids*

To Learn More, Contact Us:

U.S., Canada, Mexico: Tel. 1-800-447-4369 • Fax: 1-989-832-1465

Latin America: Tel: (+55)-11-5188-9222 • Fax: (+55)-11-5188-9749

Europe: Toll-free: +800 3 694 6367 • Tel: +32 3 450 2240 • Fax: +32 3 450 2815

Pacific: Toll-free: +800 7776 7776 • Tel: (+60) 3 7958 3392 • Fax: (+60) 3 7958 5598

Or visit us at www.dowtherm.com

NOTICE: No freedom from any patent owned by Seller or others is to be inferred. Because use conditions and applicable laws may differ from one location to another and may change with time, Customer is responsible for determining whether products and the information in this document are appropriate for Customer's use and for ensuring that Customer's workplace and disposal practices are in compliance with applicable laws and other governmental enactments. Seller assumes no obligation or liability for the information in this document. NO WARRANTIES ARE GIVEN; ALL IMPLIED WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE ARE EXPRESSLY EXCLUDED.

Published February 2008

